




ISO 9001



CÔNG TY CỔ PHẦN CÔNG NGHỆ HỢP LONG

OSS Series

# AUTOMATIC TRANSFER SWITCHES

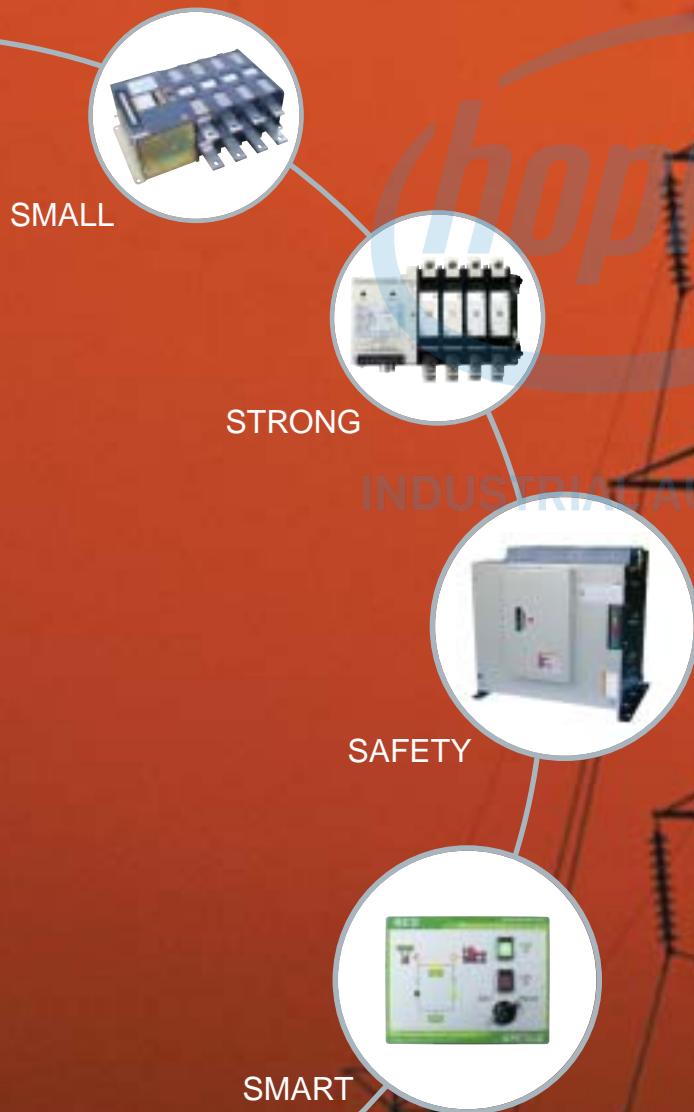**csemco**

O-Sung Electric Machinery CO., LTD.

Hotline: 1900.6536 - Website: [HOPLONGTECH.COM](http://HOPLONGTECH.COM)

# Safety Manual | 안전 주의서

## Safety Notice

These safety notices are followed by important safety information. Be sure to read these notices, product instruction and other related information thoroughly to familiarize with product handling, safety information and all other precautions before installation or maintenance.

### 이 주의서는 안전에 관한 중요한 내용을 기술하였습니다.

ATS 취급작업에 앞서 반드시 이 주의서 및 부속된 취급 설명서와 기타 부속서를 전부 읽어보시고 올바르게 사용하여 주십시오.  
기기의 지식, 안전의 정보 그리고 주의사항의 모든 것을 습득한 뒤 사용하십시오.



These safety notices are divided as "Danger" and "Caution" according to the hazard level.

이 주의서에는 안전주의 사항의 Level을 위험정도에 따라 「위험」, 「주의」로 구분하고 있습니다.



#### Caution 주의

- Do not enter the area under the Automatic Transfer Switches (ATS) when it is lifted or suspended using a lifter or chain block. The ATS may suddenly drop.  
**The ATS is heavy. Entering such an area may cause serious injury.**
- Lifter로 들어올리거나 Hoist 등으로 고정하여 들어올릴 때는 ATS의 아래에는 절대 들어가지 마십시오. ATS는 제품의 중량에 따라 낙하시 위험을 초래할 수 있습니다.



#### Caution 주의

- Installation should be performed by qualified persons.
- Prior to commencing any installation, open the upstream circuit breaker to isolate all power/voltage sources.  
**Otherwise, electric shock may occur.**
- Tighten terminal screws securely according to the specified torque.  
**Otherwise, a fire may occur.**
- Fix the Drawout type ATS firmly on a flat level using mounting screws.  
**Otherwise, drawout operation may cause the ATS to fall.**
- Avoid blocking of ATS's arc gas vents to ensure the adequate arc space.  
**Blocking of the arc gas vents could result in failure of ATS.**
- Do not place the ATS in such areas of high temperature, high humidity, dusty air, corrosive gas, strong vibration and shock or other unusual conditions.  
**Installation in such areas could cause a fire or malfunction.**
- Be careful to prevent foreign material of debris, concrete powder, iron powder, etc and rainwater from entering into the ATS.  
**These materials inside the ATS could cause a fire or malfunction.**
- For 4 pole ATS, connect the neutral wire of 3-phase, 4-wire cable to N-phase (on the right side).
- 설치는 유자격자 (전기공사기사, 전기공사기능사)가 행하십시오.
- 설치에 앞서 모든 전원을 차단하기 위해 앞단의 차단기나 또는 그러한 종류의 제품을 반드시 Open 시키십시오. 감전의 위험이 있습니다.
- 단자 Bolt는 표준 체결 Torque로 확실하게 체결하십시오. **화재의 위험이 있습니다.**
- 수평하고 평평한 면에 단단하게 축부하여 고정시키십시오. **인출작동 시 전도의 위험이 있습니다.**
- 아크가스 배출구는 막히지 않도록 아크공간(설연거리)을 충분히 확보하십시오. **가페성능을 저하시킵니다.**
- 고온, 디습, 분진, 부식성가스, 진동, 충격 등 좋지 못한 환경에 설치하지 마십시오.  
**화재 및 오동작이 발생될 수 있습니다.**
- 먼지, 콘크리트가루, 철분 등의 이물질 및 벗물 등이 ATS내부에 들어가지 않도록 시공하십시오.  
**화재 및 오동작이 발생될 수 있습니다.**
- 4극형의 경우 중성 선은 반드시 N 상극(우측)에 접속하십시오.

## Operation Precautions 조작시의 주의사항

### ⚠ Danger 위험

- Do not touch the live terminal parts.  
Otherwise, electric shock may occur.
- Do not leave the ATS in the drawout position.  
The ATS is heavy. Dropping the ATS could cause serious injury.
- 통전되고 있는 주회로 및 제어회로 단자부에는 접촉하지 마십시오. 감전의 위험이 있습니다.
- 인출 위치상에 ATS를 방지하지 마십시오. ATS는 중량물이어서 낙하시 비상한 위험을 초래할 수 있습니다.

### ⚠ Caution 주의

- The cable size of control power should be selected considering operation current.  
Otherwise, a fire could occur.
- ATS should be operated by manual handle only under no-load condition. Operation by manual handle is strictly prohibited except emergency case.  
Otherwise, damage to the ATS may occur.
- 조작전원의 전선의 굵기는 조작전류를 감안하여 선정하여 주십시오.  
절체실패시 화재를 일으킬 수 있습니다.
- ATS 수동 핸들에 의한 조작은 무부하 상태에서 조작하며, 비상시 외에는 사용을 금합니다.  
조작미숙시 개폐특성을 보증할 수 없습니다.

## Maintenance and Inspection Precautions 보수, 점검과 부품 교환시의 주의사항

### ⚠ Caution 주의

- Maintenance, inspection or components replacement should be performed by qualified persons.
- Prior to commencing any work, open the upstream circuit breaker to isolate all power/voltage sources. Otherwise, electric shock may occur.
- Prior to commencing internal inspection for ATS, Be sure that main circuit and control source of ATS should be off.  
Otherwise, fingers or tools could be pinched in the internal mechanism, causing injury.
- Retighten the terminal screws periodically according to the specified torque.  
Otherwise, a fire may occur.
- Retighten the arcing contact mounting screws periodically according to the specified torque. Otherwise, a fire or malfunction may occur.
- Be sure to reinstall the arc chute if removed.  
Failure to do so or incorrect installation may result in a fire or cause of burns.
- Do not touch the live parts or structural parts close to live parts immediately after stop of power supply to ATS.  
Otherwise, remaining heat may cause burns.
- Do not approach near the arc gas vent of arc chute while ATS is under transfer.  
Otherwise, burns may result from high temperature of arc gas.
- 보수, 점검과 부품 교환은 전문자식을 보유한 사람이 행하십시오.
- 작업은 상위차단기를 OFF 시키고 주회로, 제어회로 모두 충전되어 있지 않은 것을 확인한 뒤 행하십시오.  
감전의 위험이 있습니다.
- 내부점검은 주회로 전원 및 조작전원을 차단 후 행하십시오.  
손가락 및 공구가 기구부에 끼여 다칠 위험이 있습니다.
- 주회로 단자볼트는 정기적으로 표준 취부 Torque로써 증가시켜 취부하십시오.  
풀림은 화재 발생의 원인이 될 수 있습니다.
- 아크 접점 Screw를 정기적으로 표준 취부 Torque로써 다시 취부하십시오.  
화재나 오동작의 원인이 될 수 있습니다.
- 외부의 소호실은 반드시 취부하십시오.  
잘못된 취부 또는 취부가 되지 않을 시 화상 또는 화재의 원인이 됩니다.
- 통전정지 직후는 개폐기도전부, 특히 접점과 도전부에 균열된 구조물에 접촉하지 마십시오.  
잔류 열에 의해 화상의 위험이 있습니다.
- 절체중 소호실 아크가스 배출구에 신체를 균접하지 마십시오.  
전류차단시 고온가스가 배출되어 화상의 위험이 있습니다.

# CÔNG TY CỔ PHẦN CÔNG NGHỆ HỢP LONG



## Company History

- Dec. 1986 Established O-Sung Industrial  
Oct. 1987 Become member of Korea Electrical Manufacturers Association  
Feb. 1990 Awarded honor of KOEMA for products development  
Awarded honor of KOEMA for excellent export records  
Mar. 1990 Nominated as "Technology Intensive Enterprises" by the Office of Industrial Advancement Administration  
Jan. 1993 Authenticated of "Quality Product" for Automatic Transfer Switch by the Office of industrial Advancement Administration  
Nov. 1993 Awarded the Presidential Prize at contest for Quality Control Team  
Jun. 1995 Become member of Korea International Trade Association(KITA)  
Nov. 1995 Awarded Certificate of Quality System by Korea Standards Association Quality Assurance (KSA 9001 :1998, ISO 9002 : 1994)  
Feb. 1999 Awarded Certificate of Quality System by Korea Management Association Quality Assurance (KSA 9001 : 1998, ISO 9001 : 1994)  
Apr. 1999 ASTA certified for 2000A 50KA Air Circuit Breaker  
Feb. 2000 ASTA certified for 1600A, 3200A & 5000A 65KA Air Circuit Breaker  
May. 2000 Certified by Taiwan Power Corporation(TPC)  
Jul. 2002 CE Marked for 200A ATS  
Oct. 2005 Passed CCC(Chinese Compulsory Certification)  
Test in China for ACB  
Oct. 2005 Registered as Venture Enterprise


*Technology that captivates world!*

*Quality that delights customers!*

## C ontents

### INDUSTRIAL AUTOMATION

Safety Manual (안전 주의서)	2
<b>OSS II - T, TB Type (60~400A)</b>	<b>6</b>
Ordering Information (주문 방법)	
Feature (특징)	
Rated Specification (정격사양)	
Outline Dimension (외형도)	
Circuit Diagram (회로도)	
<b>SS - TN, TBN Type (60~600A)</b>	<b>9</b>
Ordering Information (주문 방법)	
Feature (특징)	
External View (외관명칭)	
Application and Selection (적용과 선정)	
Rated Specification (정격사양)	
Outline Dimension (외형도)	
Circuit Diagram (회로도)	
<b>OSS - PC Type (400~6300A)</b>	<b>14</b>
Ordering Information (주문 방법)	
Feature (특징)	
Rated Specification (정격사양)	
Outline Dimension (외형도)	
Circuit Diagram (회로도)	
<b>ATS Controller</b>	<b>24</b>
Specification & Function (사양 및 기능)	
Wiring Diagram (결선도)	
<b>Technical Details (기술 자료)</b>	<b>26</b>



## Ordering Information (주문방법)

OSS II - 6□-□-□P-□  
A B C D

### A Rated Current

06	1	2	4
60A	100A	200A	400A

### B Type

- ▶ T : T-Type
- ▶ TB : TB-Type

### C Number of Poles

- ▶ 2 : 2P
- ▶ 3 : 3P
- ▶ 4 : 4P

### D Operating Voltage


- ▶ A1 : AC 110V
- ▶ A2 : AC 220V
- ▶ D1 : DC 110V
- ▶ D2 : DC 125V

## Features (특징)

- Sure operating latch mechanism.
- High current capacity with low operating current.
- Good closing performance.
- Compact and light weight.
- Suitable for emergency power supply facilities.
- 우수한 “레치”에 의한 확실한 동작
- 최소의 조작전류로서 최대의 통전 성능
- 우수한 개폐 기능
- 소형 / 경량
- 비상 전력공급설비에 적합


## Rated Specification (정격사양)

TYPE		606-T, 606-TB 61-T, 61-TB		62-T, 62-TB		64-T, 64-TB					
Rated Operational Voltage (정격사용전압)	Ue			AC 600V, DC 125V							
Rated Current (정격전류)	Ie	60A, 100A		200A		400A					
Neutral Phase Current (중성극전류)		60A, 100A		200A		400A					
Kind of Throw (투수)		Double Throw (쌍투)									
Connection (접속방식)		Front(T), Back(TB) (표면, 배면)									
Number of poles (극수)		2P	3P	4P	2P	3P	4P				
Weight (중량)		14kg	16kg	18kg	16kg	19kg	22kg				
Rated Short-Time Withstand Current (1sec) (정격 단시간 전류)	Icw	5kA		10kA		12kA					
Short-Circuit Making Capacity (단락 피크 전류)	Icm	7.65kA		17kA		24kA					
Switching Capacity (개폐 용량)		AC - 33B (6le making / 6le breaking cos Ø= 0.5) DC - 31B (1.5le making / 1.5le breaking L/R = 1ms)									
Switching Frequency (개폐빈도)		60Time / Hour									
Operating Current (조작전류) rms/pick	DC 110V / 125V	14A		14A		14A					
	AC 100V / 110V	7A/14A		7A/14A		7A/14A					
	AC 200V / 240V	3.5A/7A		3.5A/7A		3.5A/7A					
Operating Time (동작시간)	Change - over time	≤ 80 ms									
	Opening time	≤ 60 ms									
Number of Operating Cycles (정격개폐회수)	Without Current (무통전)	10,000									
	With Current (통전)	5,000									
Cautions (주의사항)	1. For complete operation, Be sure to provide control source for more than 0.5sec. 2. When control source will be provided to A side and B side simultaneously, Coil may be damaged. 3. Control Relay should be selected considering sufficient contact capacity to withstand against more than control current. 1. 조작지령은 0.5sec이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. A측, B측 동시 조작지령시 코일 소손의 원인이 됩니다. 3. 조작 Relay는 조작전류 이상의 충분한 접점용량을 선정하여 주십시오.										




## Outline Dimension (외형도)

OSSII - T Type

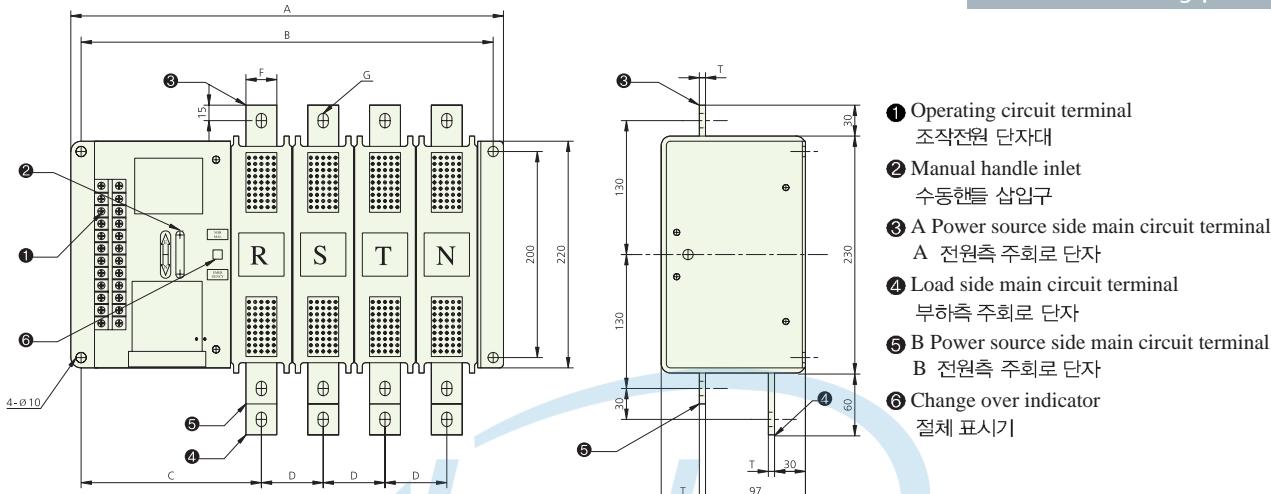


OSSII - TB Type

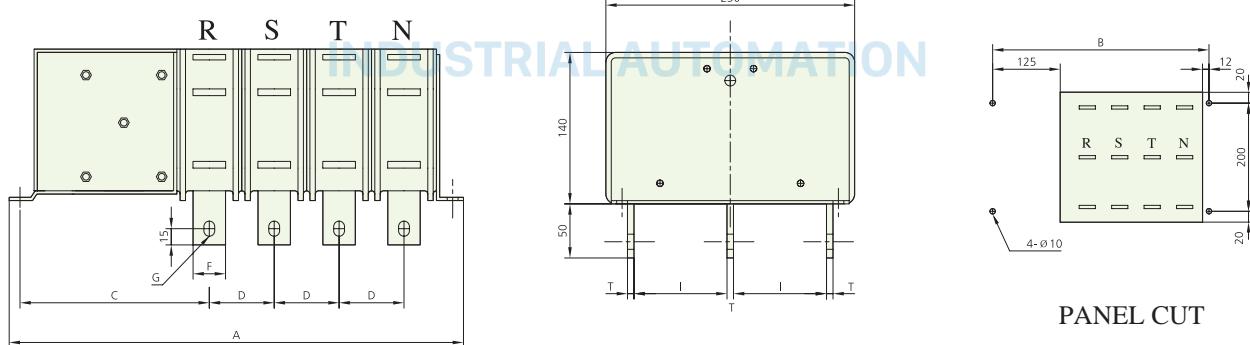


unit : mm

MODEL	CURRENT	POLE	A	B	C	D	F	G	I	T
606~61-T 606~61-TB	60A 100A	2 P	280	260	170	50	20	Ø 8	87	4
		3 P	330	310						
		4 P	380	360						
62-T 62-TB	200A	2 P	300	280	175	60	30	Ø 10	86	6
		3 P	360	340						
		4 P	420	400						
64-T 64-TB	400A	2 P	300	280	175	60	30	Ø 10	86	6
		3 P	360	340						
		4 P	420	400						




### Circuit Diagram (회로도)

AC 110V, AC 220V

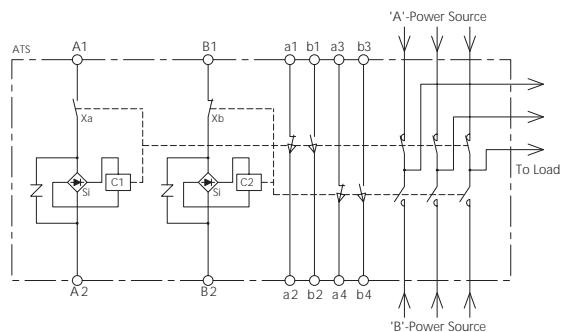

DC 110V, DC 125V

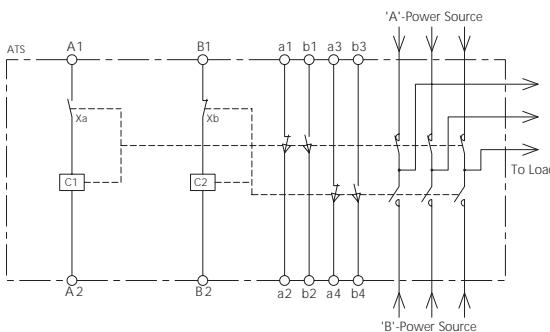


A1 , A2	A-Power Closing Terminal	Xa , Xb	Control Switch
B1 , B2	B-Power Closing Terminal	a1, a2, a3, a4	A-Power Aux Switch
C1	A-Power Closing Coil	b1, b2, b3, b4	B-Power Aux Switch
C2	B-Power Closing Coil	Si	Silicon Rectifier

### Typical Operating Circuit (대표적 조작회로 예)


Standard

(일반적인 절체)

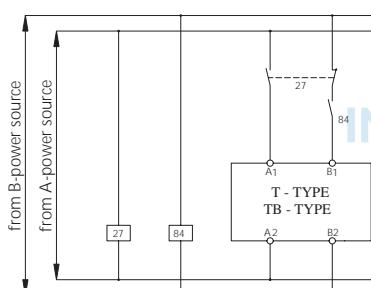


In case of using a changeover switch

(수동-자동 절체)

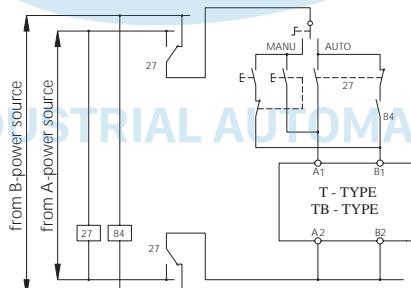


In case of using a timer

(타이머를 이용한 절체)

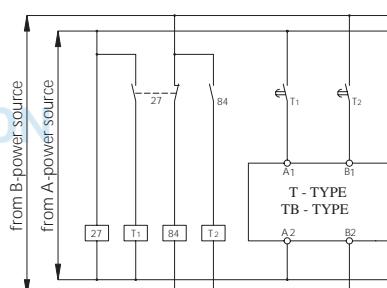


### Wiring Diagram (결선도)

AC Operating and Control

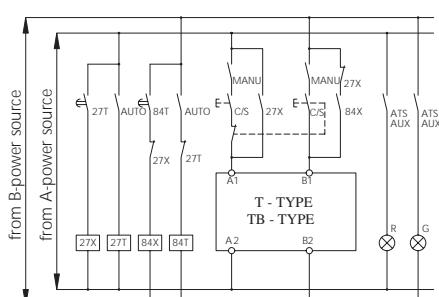

DC Operating and Control

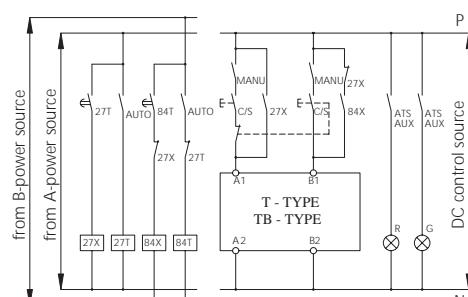

27X Source-A Operating Relay

84X Source-B Operating Relay

27T 27X Operating Delay Relay

84T 84X Operating Delay Relay

AUTO,MAN Automatic , Manual

C/S Control Switch



## Ordering Information (주문방법)

### A Rated Current

06	1	2	4	6
60A	100A	200A	400A	600A

### B Type

- TN : TN-Type
- TBN : TBN-Type

### C Number of Poles

- 2 : 2P
- 3 : 3P
- 4 : 4P

### D Operating Voltage

- A1 : AC 110V
- A2 : AC 220V
- D1 : DC 110V
- D2 : DC 125V

## Features (특징)

### ■ Neutral Point Method

When transfer is accompanied by uninterrupted power to the load, it is recommended to transfer after checking circuit stability rather than instant transferring in case of power failure or restoration. In order to meet these requirements, positioning at neutral point(off-position) can be set by tripping mechanism as follows.

A⇒Off⇒B, B⇒Off⇒A, and A⇒Off⇒A, B⇒Off⇒B  
And also, instantaneous transfer can be performed by operating signal.

### ■ One-Coil Application

One-coil is employed for the transfer of normal power source and emergency power source.

### ■ Compact & Lightweight Design

Compact & lightweight design makes the minimized mounting space and easier installation.

### ■ Excellent Breaking Capacity

It is designed for large arc-extinguishing chamber sufficient enough to interrupt large amount of arcing current. Arc-extinguishing contacts are designed for easier inspection and maintenance.

### ■ Protection against Residual Voltage

Setting for delayed transfer time is available by external sequence. Thus, collision between power source and residual voltage of load can be protected.

### ■ Construction for Safety

For safe operation, molded construction is employed on breaking parts. And also, latching indicator is prepared to indicate the latching condition.

## External View (외관명칭)

- ① Earthing Terminal (접지단자)
- ② Manual Operating Shaft (Anti-Clockwise) (수동조작 바)
- ③ Circuit Diagram (회로도)
- ④ Name Plate (명판)
- ⑤ Trip Button (트립 버튼)
- ⑥ Selective Button for "B" Power-Closing (선택 버튼)
- ⑦ On/Off Indicator (동작표시기)
- ⑧ Circuit Terminal for "A" Power (A전원측 주회로 단자)
- ⑨ Contacts (접점부)
- ⑩ Arc-Extinguishing Chamber (소호실)
- ⑪ Aux Switch (보조스위치)
- ⑫ Circuit Terminal for "B" Power (B전원측 주회로 단자)
- ⑬ Control Circuit Terminal Block (조작전원 단자대)
- ⑭ Main Circuit Terminal for Load (부하측 주회로 단자)
- ⑮ Amateur for Closing Coil (투입 코일)

### ■ 중간정지 방식

무정전 전원장치가 있는 경우 정전 또는 복전시 긴급 절체 되는 것 보다는 회로의 안정 및 안전을 확인한 후 절체 할 수 있는 방식으로 트립장치에 의해 중간위치(off)가 가능합니다.

A⇒Off⇒B, B⇒Off⇒A, and A⇒Off⇒A, B⇒Off⇒B

또한 조작 지령에 의해 종전율과 동일하게 긴급 절체도 가능합니다.

A⇒B, B⇒A

### ■ 단일코일 방식

한개의 코일로 절체하는 방식입니다.

### ■ 소형 경량

작고 가벼워 공간 활용 및 작업자 능률이 높아집니다.

### ■ 강력한 차단 능력


독특한 구조의 소호실 설계로 아크차단이 짧고 접점의 소모가 적어 장기간 사용 가능하며 전면에서 소호실을 열수 있어 내부 접점의 점검이 편리합니다.


### ■ 부하측 전류전원 훈족 방지

Neutral(OFF)부의 TN형은 외부시퀀스에 의해 절체시간을 임의 설정하여 전원과 부하측 전류 전압과의 훈족을 확실하게 방지할 수 있습니다.

### ■ 안전 구조 설계

차단부가 분진방지형 몰드구조로 설계되었고, 동작 위치 표시기가 있어 수명이 길고 사용자가 안전합니다.

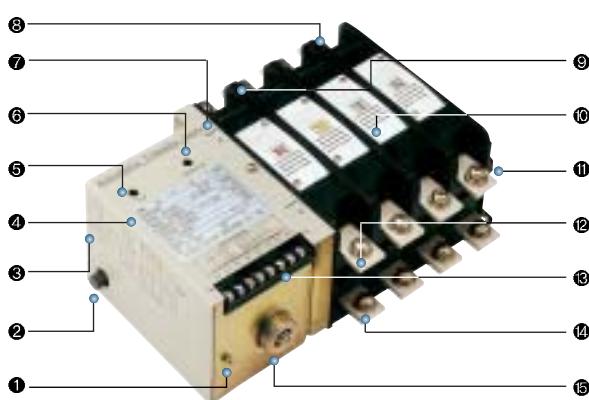



## Application and Selection (적용과 선정)

### ■ Applicable Standards

- IEC 60947-6-1 · JEM 1038 · UL 1008
- KSC 4504 · KSC 0703

### ■ Control Order

Input and trip delayed operation is completed within 0.3 sec, However, sequence setting is required to control with more than 0.5 sec.

### ■ Interlock

Interlocking is required for control circuit so that control order should not supply to both A power source side and B power source side simultaneously. For TN type ATS, Sequence setting is required so that closing or tripping order should not supply in the same direction.

### ■ Control Circuit

ATS is designed so that operation current should be off by internal switch after completion of operation. If operation current is off with auxiliary switch of the unit, it may cause a malfunction.

### ■ 관련 규격

- IEC 60947-6-1 · JEM 1038 · UL 1008
- KSC 4504 · KSC 0703

### ■ 제어 지령

투입 및 트립 절제동작은 0.3초이내에 완료 되지만 0.5초 이상의 제어 지령으로 동작될 수 있도록 Sequence를 설정하여 주십시오.

### ■ 인터록

조작회로에는 A전원측과 B전원측에 동시지령이 되지 않도록 인터록(전기적)을 설치하여 주십시오. TN형의 경우 동일방향으로 투입, 트립 지령이 되지 않도록 Sequence를 설정하여 주십시오.

### ■ 제어 회로

ATS는 동작완료 후 내부 SW에 의해 조작전류를 OFF하도록 설계되어 있습니다. 본체의 보조 SW로 조작전류를 OFF하면 오동작의 원인이 됩니다.


## Rated Specification(정격사양)

TYPE	606-TN, TBN 61-TN, TBN		62-TN, TBN		64-TN, TBN 66-TN, TBN					
Rated Operational Voltage (정격사용전압) Ue			AC 600V, DC 125V							
Rated Current (정격전류) Ie	60A, 100A		200A		400A, 600A					
Neutral Phase Current (중성극전류)	60A, 100A		200A		400A, 600A					
Kind of Throw (투수)	Double Throw (쌍투)									
Connection (접속방식)	Front(TN), Back(TBN) (표면, 배면)									
Number of poles (극수)	2P	3P	4P	2P	3P	4P				
Weight (중량)	14kg	16kg	18kg	16kg	19kg	22kg				
Rated Short-Time Withstand Current (1sec) (정격 단시간 전류)	Icw	5kA		10kA		12kA				
Short-Circuit Making Capacity (단락 피크 전류)	Icm	7.65kA		17kA		24kA				
Switching Capacity (개폐 용량)	AC - 33B (6le making / 6le breaking cos $\phi$ = 0.5) DC - 31B (1.5le making / 1.5le breaking L/R = 1ms)									
Switching Frequency (개폐빈도)	60Time / Hour									
Operating Current (조작전류) rms/pick	DC 110V / 125V	6A		6A		7A				
	AC 100V / 110V	3A/6A		3A/6A		3.5A/7A				
	AC 200V / 240V	1.5A/3A		1.5A/3A		2A/3.5A				
	Trip Coil Current	DC 110V = 2.5A, AC 110A = 2.5A, AC 220V = 1.5A								
Operating Time (동작시간)	"A" POWER	Making	$\leq 55$ ms		$\leq 55$ ms		$\leq 60$ ms			
		Breaking	$\leq 20$ ms		$\leq 20$ ms		$\leq 25$ ms			
	"B" POWER	Making	$\leq 80$ ms		$\leq 80$ ms		$\leq 90$ ms			
		Breaking	$\leq 20$ ms		$\leq 20$ ms		$\leq 25$ ms			
Number of Operating Cycles (정격개폐수명)	Without Current (무통전)		10,000							
	With Current (통전)		5,000							
Cautions (주의사항)	1. For complete operation, Be sure to provide control source for more than 0.5sec. 2. When control source will be provided to A side and B side simultaneously, Coil may be damaged. 3. Control Relay should be selected considering sufficient contact capacity to withstand against more than control current. 1. 조작지령은 0.5sec이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. A측, B측 동시 조작지령시 코일 소손의 원인이 됩니다. 3. 조작 Relay는 조작전류 이상의 충분한 접점용량을 선정하여 주십시오.									



## Outline Dimension (외형도)


60A, 100A

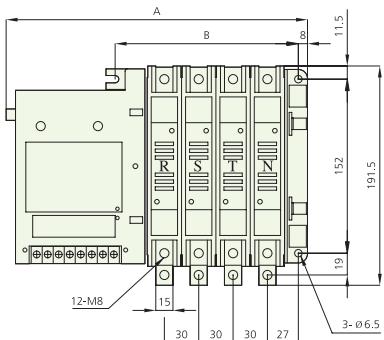

606-TN, 61-TN

	Dimension (mm)	
Pole	A	B
2 P	204	100
3 P	234	130
4 P	264	160


200A

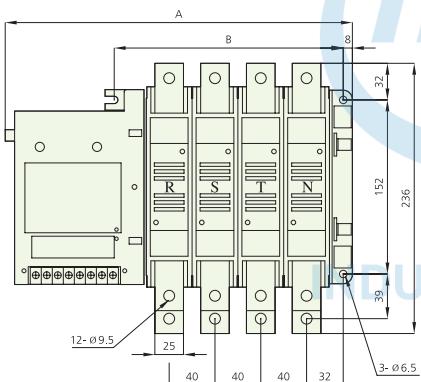

62-TN

	Dimension (mm)	
Pole	A	B
2 P	224	120
3 P	264	160
4 P	304	200

400A, 600A

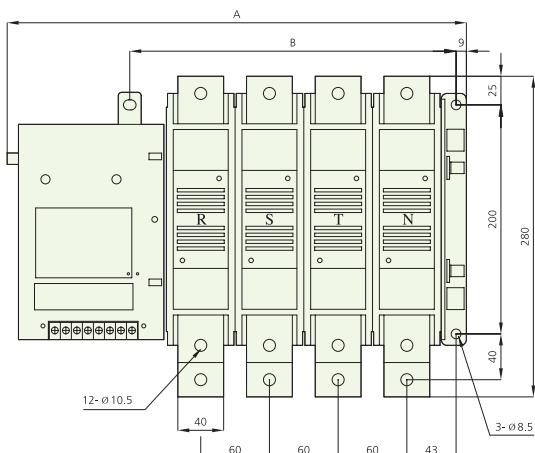

64-TN, 66-TN





\* Arc space for main circuit  
- 30mm for AC 220V  
- 60mm for AC 660V

	Dimension (mm)	
Pole	A	B
2 P	283	165
3 P	343	225
4 P	403	285



## Outline Dimension (외형도)

606-TBN~66-TBN

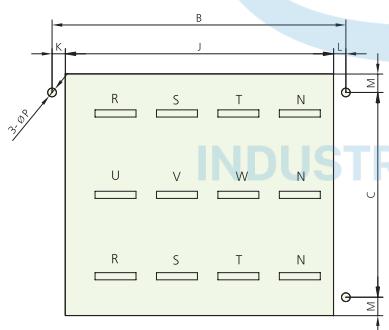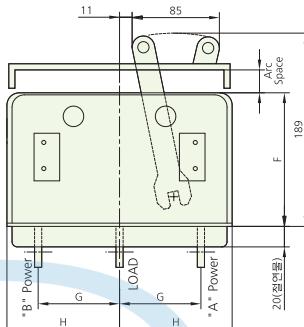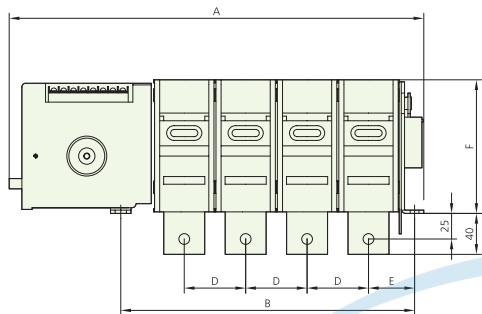

	606-TBN 61-TBN	62-TBN	64-TBN	66-TBN
W	15	25	40	
U	Ø 8.5		Ø 10.5	
t	4	5	7	

PANEL CUTTING


TERMINAL THICKNESS

unit : mm

		A	B	C	D	E	F	G	H	J	K	L	M	P
606-TBN 61-TBN	2 P	206	102	152	30	29	110.5	62.5	87.5	82	9	11	19	Ø 6.5
	3 P	236	132							112				
	4 P	266	162							142				
62-TBN	2 P	226	122	152	40	34	110.5	63	87.5	102	9	11	19	Ø 6.5
	3 P	266	162							142				
	4 P	306	202							182				
64-TBN 66-TBN	2 P	285	167	200	60	45	130.5	79.5	110	142	13	12	18	Ø 8.5
	3 P	345	227							202				
	4 P	405	287							262				



### Circuit Diagram (회로도)

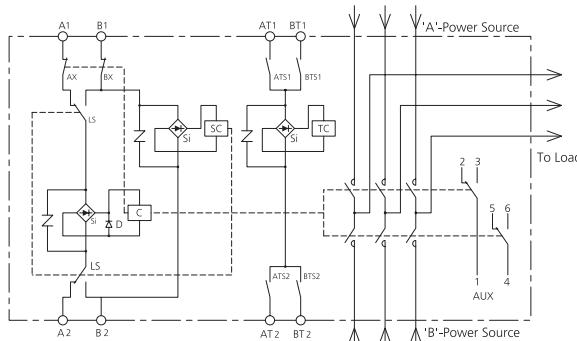


A1 , A2	A-Power Closing Terminal	C	Closing Coil
B1 , B2	B-Power Closing Terminal	SC	Selective Coil
AT1 , AT2	A-Power Tripping Terminal	TC	Tripping Coil
BT1 , BT2	B-Power Tripping Terminal	AX , BX	Control Switch
AUX	Aux Switch	ATS1 , ATS2 BTS1 , BTS2	Trip Control Switch
Si	Silicon Rectifier	LS	Selective Switch

### Typical Operating Circuit (대표적 조작회로 예)


#### Standard

(일반적인 절체)

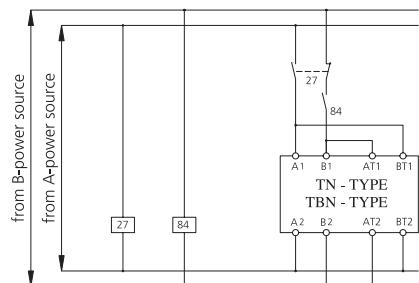


#### In case of using a changeover switch

(수동-자동 절체)

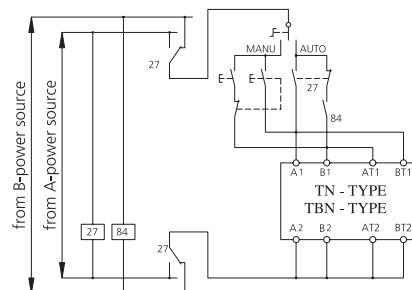


#### In case of using a timer

(타이머를 이용한 절체)

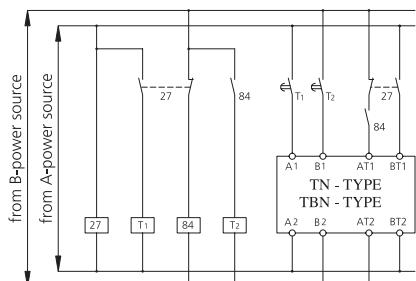

#### In case of using a condenser tripping device

(콘덴서 트립)

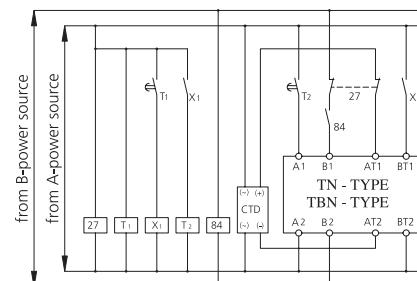



## Ordering Information (주문방법)

OSS - 6□-□-□P-□-□  
A B C D E

### A Rated Current

04	06	08	10	12	16	20	25	32	40	50	63
400A	630A	800A	1000A	1250A	1600A	2000A	2500A	3200A	4000A	5000A	6300A

### B Type

- ▶ PC : Standard
- ▶ PCO : Overlapping contacts

### C Number of Poles

- ▶ 3 : 3P
- ▶ 4 : 4P

### D Operating Voltage

- ▶ A1 : AC 110V
- ▶ A2 : AC 220V
- ▶ D1 : DC 110V
- ▶ D2 : DC 125V

### E Mounting System

- ▶ F : Fixed
- ▶ D : Draw out

## Features (특징)

### ■ One coil mechanism

One coil mechanism is applied.

### ■ Transfer indicator provided

Transfer indicator is fitted to indicate the transfer status.

### ■ Easier busbar arrangement

When ATS will be installed with ACB in switchgear, Busbars can be easily arranged.

### ■ Fixed type & Drawout type available

Fixed type and Drawout type are available for customer's convenient application.

### ■ Quick replacement of ATS

When fault will occur, Drawout type ATS can be replaced within 5 minutes.

### ■ Complete transfer ensured

By spring transfer mechanism, incomplete transfer of conventional ATS can be entirely eliminated and complete transfer can be ensured.

### ■ Sufficient current capacity

Sufficient current carrying contacts are designed to withstand against over current.

### ■ Minimized opening & Closing impact

Opening and closing impact is minimized.

### ■ Overlapping function for N-phase Option

This function is added as option on Neutral Contacts of PC-type ATS and enables followings.

- Overlapping of Neutral Contacts both to A side and B side.
- Opening of Neutral Contacts later than other 3-phase Contacts.

### ■ 1코일 절체 기구

정평이 있는 1코일 절체기구를 채택 했습니다.

### ■ 절체표시기 부착

절체의 상태를 확인할 수 있는 절체표시기를 부착하였습니다.

### ■ 부스바작업간편

ACB와 함께 배전반 설치시 부스바작업이 간편합니다.

### ■ 다양한 고객요구를 만족

고정형과 인출형이 있어 다양한 고객요구를 만족 시킬 수 있습니다.

### ■ ATS교체 시간 단축

인출형이 있어 사고발생시 ATS교체 시간이 5분 이내입니다.

### ■ 불완전 투입요소 완전 제거

SPRING 절체타입으로 기존의 ATS의 문제점인 불완전 투입요소를 완전하게 제거 하였습니다.

### ■ 과전류 방지

통전부의 독특한 접점구조에 의해서 과전류에 충분히 이거 낼 수 있도록 설계되어 있습니다.

### ■ 개폐소크 미미

개폐 조작시 개폐소크가 극소 합니다.

### ■ 중성선(N상) 중첩절환기능 Option

ATS의 중성접점(Neutral Contact)에 기능을 추가하여 ATS절환 시 중성접점이 A측과 B측에 중첩되어 붙고 다른 3접점(삼상)에 비하여 나중에 떨어지는 방식을 중첩절환기능이라 합니다.



## Necessity of overlapping function for N-phase (N상 중첩절환기능의 필요성)

■ Neutral Contacts of general ATS are closed earlier and are opened later than 3-phase Contacts. When general ATS will be transferred, Arc will be generated between fixed contacts and moving contacts. Thus, current flows between contacts. Arc will be eliminated when current will be at zero level. Eliminating time of arc is 10-12 msec. Therefore, various devices of load side can be protected while Neutral Contacts should be opened 10-12 msec later than other 3-phase Contacts.

Load side devices of general ATS cannot be sufficiently protected because opening time gap between Neutral Contacts and other 3-phase Contacts is less than 10 msec.

In order to solve this problem, Overlapping is functioned between Neutral Contacts of A-power (Utility) and B-power (Emergency) during transfer of ATS. Thus, various devices of load side can be protected more safely.

In addition, Non-linear load increases the earth potential and potential difference is occurred between earth and neutral line. When general ATS will be transferred, Neutral line is separated from load and reference potential difference cannot be established. Thus, Floating is occurred and electronic devices can be malfunctioned. When ATS with overlapping function will be applied, Floating can be protected.

### ■ Location needed for overlapping function

- Broadcasting system and telecommunication system
- Bank and computer center
- Petrochemical plant
- Military communication system and radar facilities
- Arc furnace
- Large harmonic load (Elevator & Escalator, etc)

■ 일반적인 ATS의 경우 중성점점(N상)이 다른 3점점(삼상)보다 먼저 붙고 나중에 떨어지는 것을 기본으로 하고 있습니다.

일반적인 ATS는 절체 시 고정자와 가동자의 접점사이에서 ARC가 발생하여 접촉자간에 전류를 지속 시키게 되며, ARC는 전류의 영점에서 사라져 없어지게 됩니다.

이때, ARC의 소멸시간은 대략 10~12msec 정도가 됩니다.

그러므로 중성점점(N상)은 다른 3점점(삼상)보다 10~12msec후에 떨어져야 부하측의 각종 장비가 보호 됩니다.

그러나 일반적인 ATS는 중성점점(N상)과 다른 3점점(삼상)의 시간차가 10msec 이내가 되므로 부하측의 설비를 보호하는데 다소 미흡하다 할 수 있습니다.


이러한 문제를 해결하기 위하여 상용전원의 중성점점과 비상전원의 중성점점을 중첩시켜 절체 시킴으로써 보다 안전하게 부하측의 각종 장비를 보호 할 수 있습니다.

또한, 비선형부하는 대지전위를 상승시켜 대지와 중성선간에 전위차가 생기므로 일반적인 ATS는 절체 시 중성선이 부하측과 분리되어 기준전위가 확립되지 않아 플로팅현상이 발생되어 전자장비가 오동작을 유발합니다.


그러므로 중첩절환 기능이 내장된 ATS를 사용함으로써 플로팅현상을 예방 할 수 있습니다.

### ■ 중첩절환기능을 필요로 하는 장소로는 다음과 같습니다.

- 방송국 및 전신전화국
- 은행 및 전산시설
- 석유 화학 플랜트
- 군 통신 및 레이더 시설
- 각종 전기로
- 다양한 고조파 발생 부하 (엘리베이터, 에스컬레이터 등)

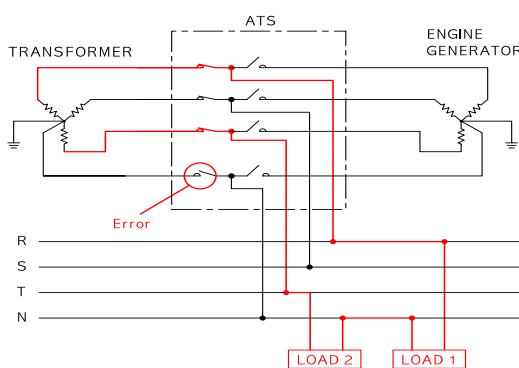

General ATS

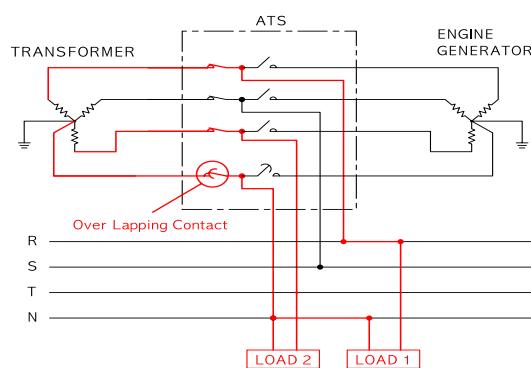

Overlapping function ATS



## Rated Specification (정격사항)

TYPE		604-PC 606-PC		608-PC 610-PC		612-PC		616-PC		620-PC							
Rated Voltage (정격 전압)	Ue	AC 600V, DC 125V															
Rated Current (정격 전류)	Ie	400A, 630A		800A, 1000A		1250A		1600A		2000A							
Neutral Phase Current (중성 극전류)		400A, 630A		800A, 1000A		1250A		1600A		2000A							
Kind of Throw (투수)		Double Throw (쌍투)															
Connection (접속 방식)		Back (배면)															
Number of Poles (극수)		3P	4P	3P	4P	3P	4P	3P	4P	3P	4P						
Weight (중량)	Fixed (고정)	50kg	60kg	55kg	65kg	60kg	70kg	65kg	75kg	75kg	90kg						
	Drawout (인출)	75kg	90kg	80kg	95kg	90kg	105kg	95kg	110kg	110kg	140kg						
Rated Short-Time Withstand Current (1sec) (정격 단시간 전류)	Icw	20kA		25kA		30kA		35kA		40kA							
Short-Circuit Making Capacity (단락 Pick 전류)	Icm	40kA		52.5kA		63kA		73.5kA		84kA							
Switching Capacity (개폐 용량)		AC -33B (6 le making / 6 le breaking cos Ø= 0.5) DC -31B (1.5 le making / 1.5 le breaking L/R=1ms)															
Switching Frequency (개폐빈도)		60Time / Hour				20Time / Hour				10Time / Hour							
Operating Current (조작전류) rms/pick	DC 110V / 125V	45A				50A				65A							
	AC 100V / 110V	23A/45A				25A/50A				33A/65A							
	AC 200V / 240V	15A/30A				20A/40A				25A/50A							
Operating Time (동작시간)	Change - over time	≤ 120 ms															
	Opening time	≤ 90 ms															
Number of Operating Cycles (정격 개폐 회수)	Without Current	10,000						5,000									
	With Current	5,000						3,000									
Cautions (주의사항)		1. For complete operation, Be sure to provide control source for more than 0.5sec. 2. When control source will be provided to A side and B side simultaneously, Coil may be damaged. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. A측, B측 동시 조작지령시 코일 소손의 원인이 됩니다.															




TYPE		625-PC		632-PC		640-PC		650-PC		663-PC							
Rated Voltage (정격 전압)	Ue	AC 600V, DC 125V															
Rated Current (정격 전류)	Ie	2500A		3200A		4000A		5000A		6300A							
Neutral Phase Current (중성 극전류)		2500A		3200A		4000A		5000A		6300A							
Kind of Throw (투수)		Double Throw (쌍투)															
Connection (접속 방식)		Back (배면)															
Number of Poles (극수)		3P	4P	3P	4P	3P	4P	3P	4P	3P	4P						
Weight (중량)	Fixed (고정)	75kg	90kg	80kg	100kg	145kg	180kg	160kg	200kg	160kg	200kg						
	Drawout (인출)	110kg	140kg	125kg	155kg	220kg	275kg	245kg	305kg	245kg	305kg						
Rated Short-Time Withstand Current (1sec) (정격 단시간 전류)	Icw	50kA		50kA		65kA		65kA		65kA							
Short-Circuit Making Capacity (단락 Pick 전류)	Icm	105kA		105kA		143kA		143kA		143kA							
Switching Capacity (개폐 용량)		AC -33B (6 le making / 6 le breaking cos Ø= 0.5) DC -31B (1.5 le making / 1.5 le breaking L/R=1ms)															
Switching Frequency (개폐빈도)		10Time / Hour															
Operating Current (조작전류) rms/pick	DC 110V / 125V	65A				80A											
	AC 100V / 110V	33A/65A				40A/80A											
	AC 200V / 240V	25A/50A				33A/65A											
Operating Time (동작시간)	Change - over time	≤ 120 ms															
	Opening time	≤ 90 ms															
Number of Operating Cycles (정격 개폐 회수)	Without Current	5,000				3,000											
	With Current	3,000				1,500											
Cautions (주의사항)		1. For complete operation, Be sure to provide control source for more than 0.5sec. 2. When control source will be provided to A side and B side simultaneously, Coil may be damaged. 1. 조작지령은 0.5sec 이상으로 하여 확실한 동작을 할 수 있도록 하여 주십시오. 2. A측, B측 동시 조작지령시 코일 소손의 원인이 됩니다.															



## Outline Dimension (외형도)

400~1600A Fixed



unit : mm

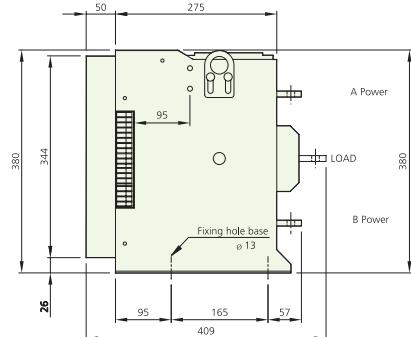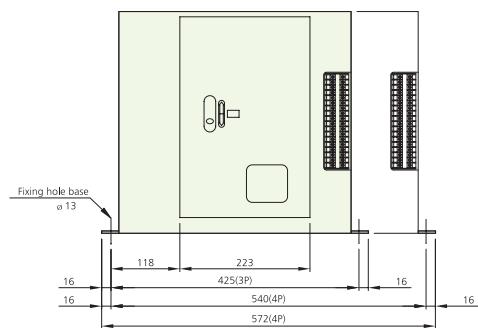

Poles	A	B
3P	425	325
4P	540	440




Panel cutting  
(Fixing hole)

OSS-604~610-PC


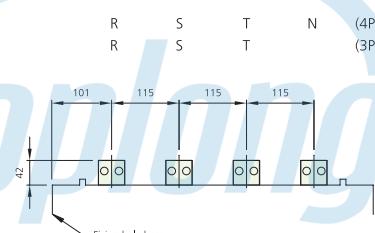
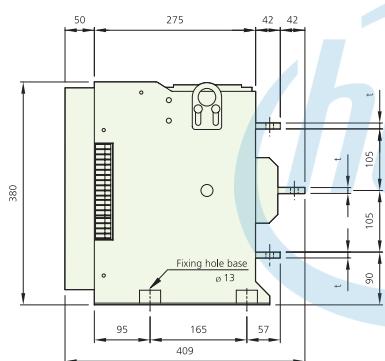


Current	Thickness
400~630A	6
800~1000A	10

OSS-612-PC

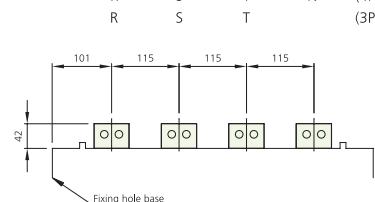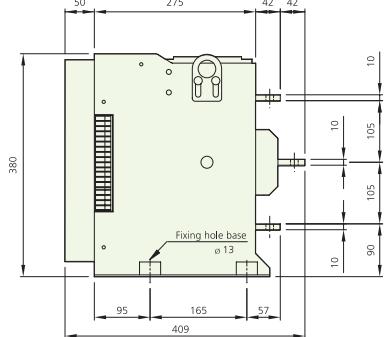

OSS-616-PC


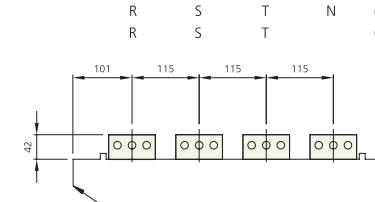
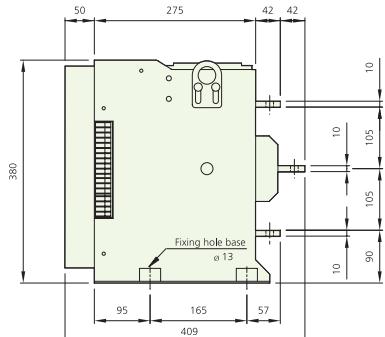




## Outline Dimension (외형도)

2000~3200A Fixed




unit : mm

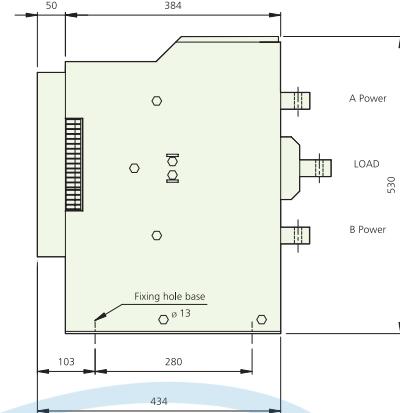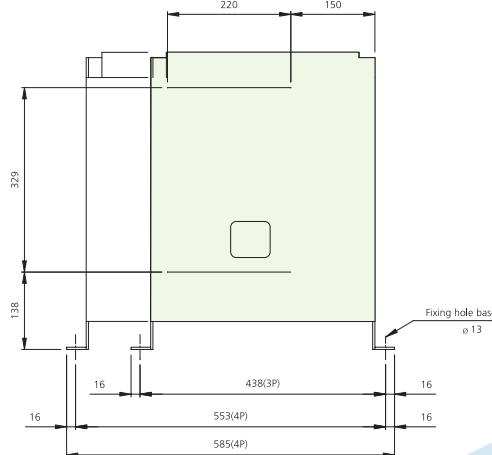




Poles	A	B
3P	438	338
4P	553	453

Panel cutting  
(Fixing hole)

OSS-620~625-PC

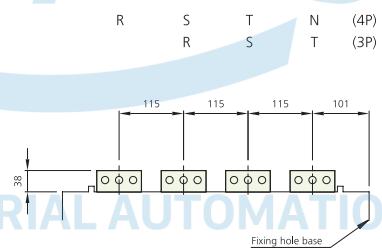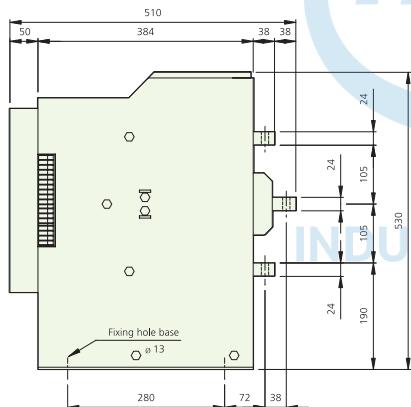

OSS-632-PC


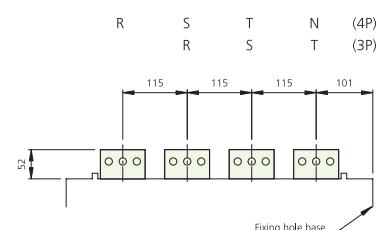
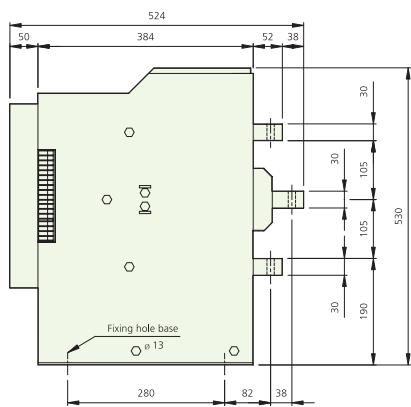





## Outline Dimension (외형도)

4000~6300A Fixed

unit : mm

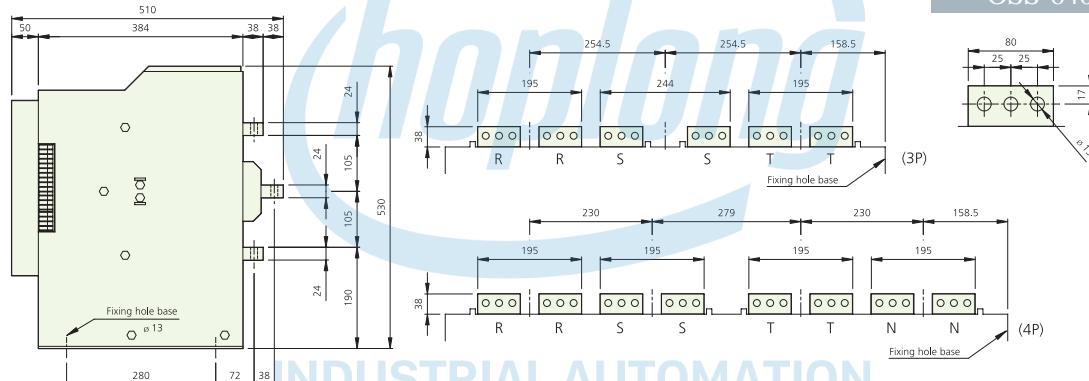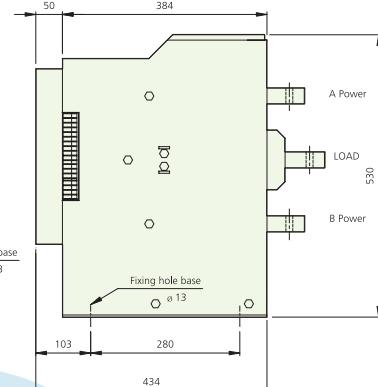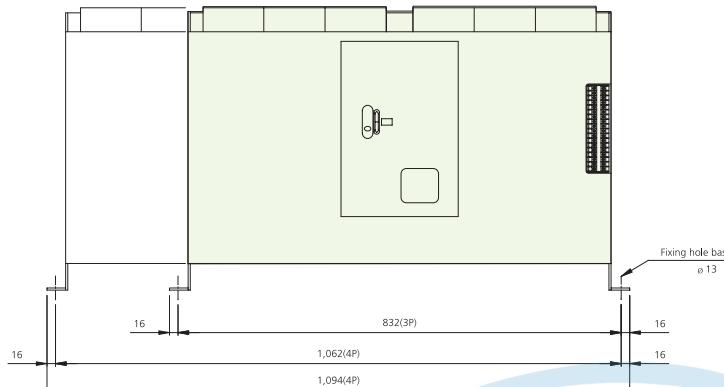


OSS-640-PC

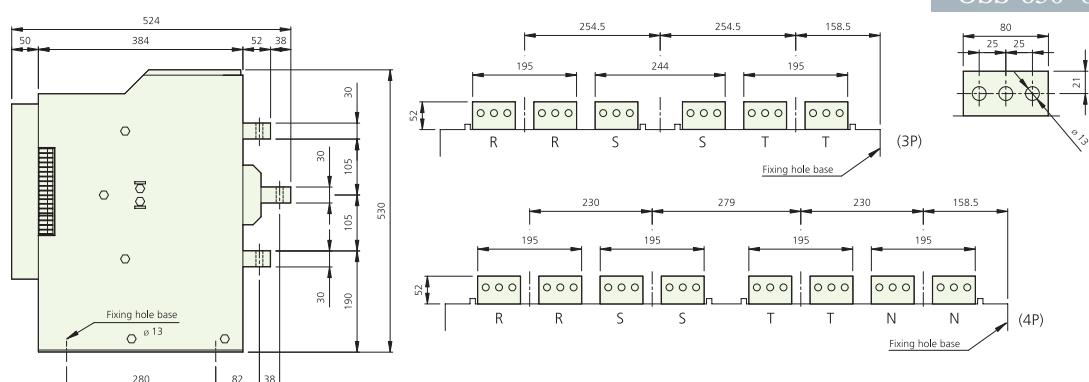

OSS-650~663-PC

## Panel cutting (Fixing hole)




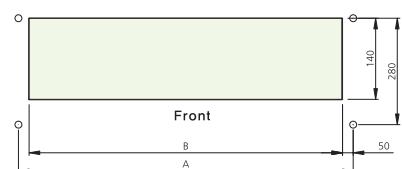


Poles	A	B
3P	832	732
4P	1062	962




### Outline Dimension (외형도)



400~1600A Draw Out

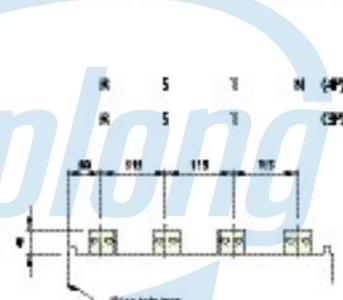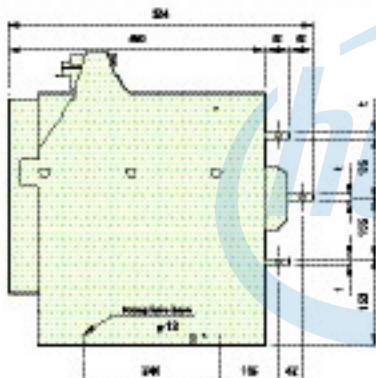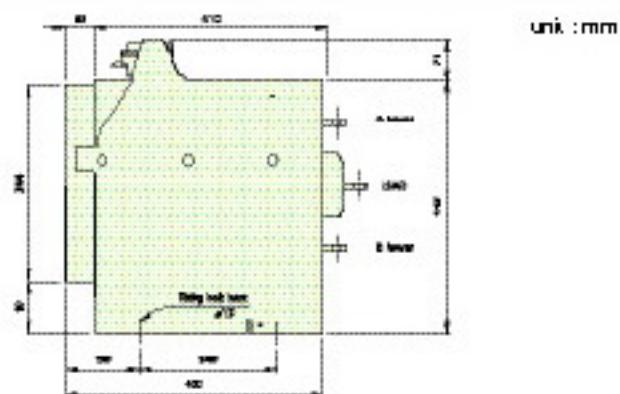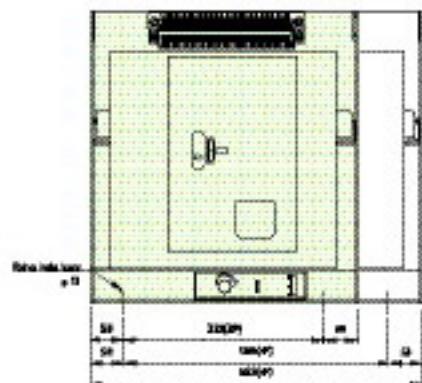




OSS-610-PC




Current	Thickness
400-630A	6
800-1000A	10

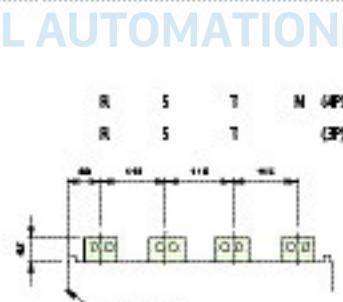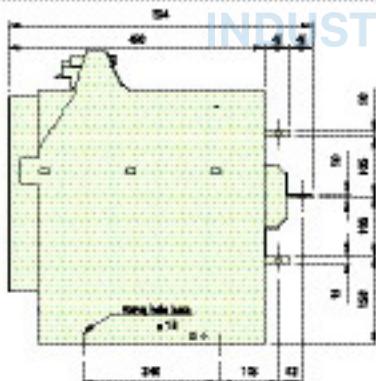

OSS-612-PC

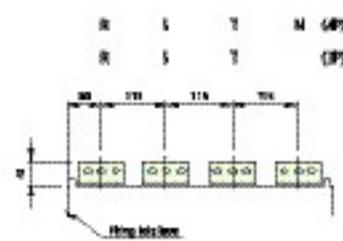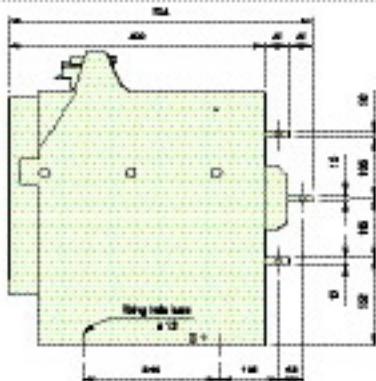



OSS-616-PC






### Outline Dimension (외형도)

2000~3200A Draw Out

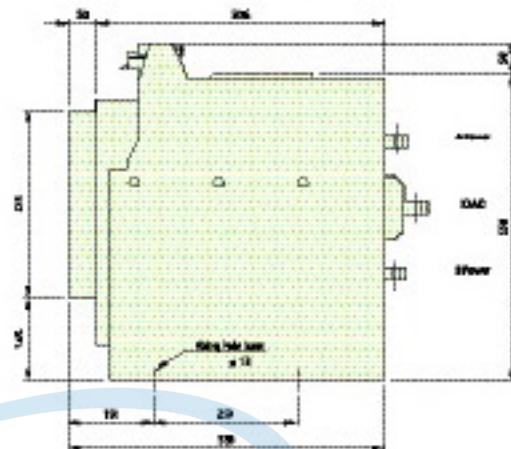
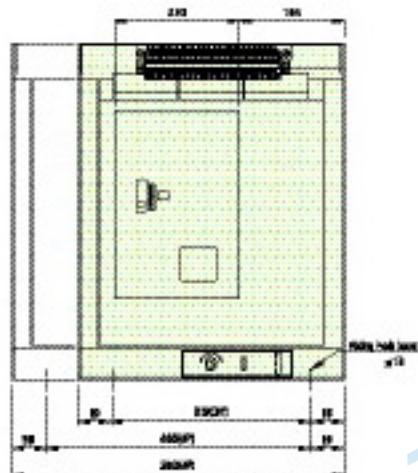


unit : mm


OSS-610~615-PC

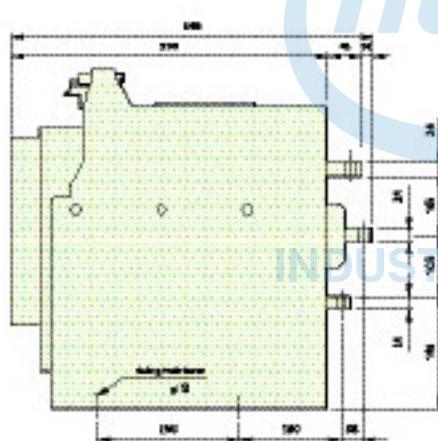



K 1 T N (P)  
I S T (G)



OSS-632-PC

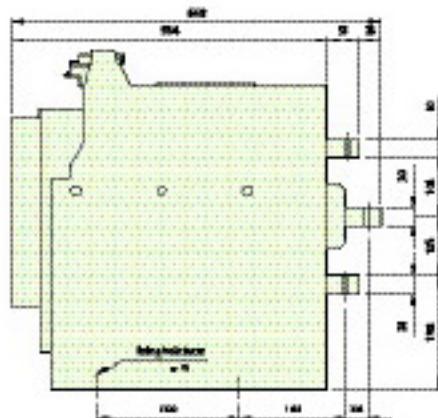

K 1 T N (P)  
I S T (G)


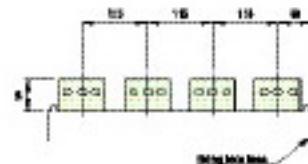





### Outline Dimension (외형도)

4000~6300A Draw Out


unit : mm

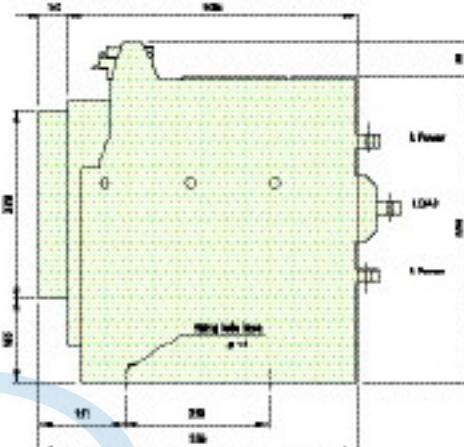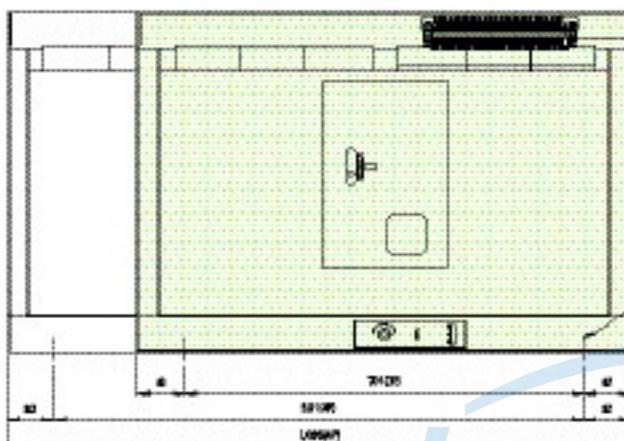

OSS-640-PC

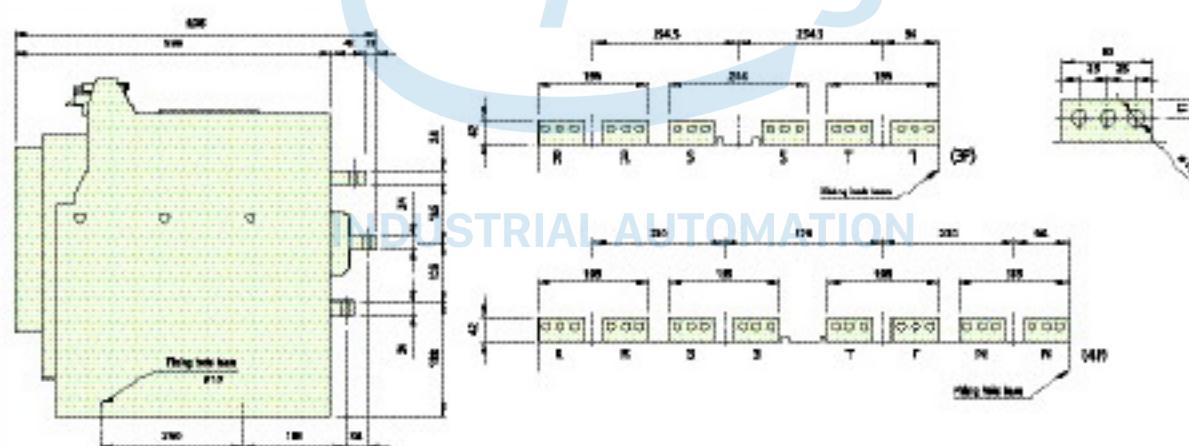


OSS-650~663-PC

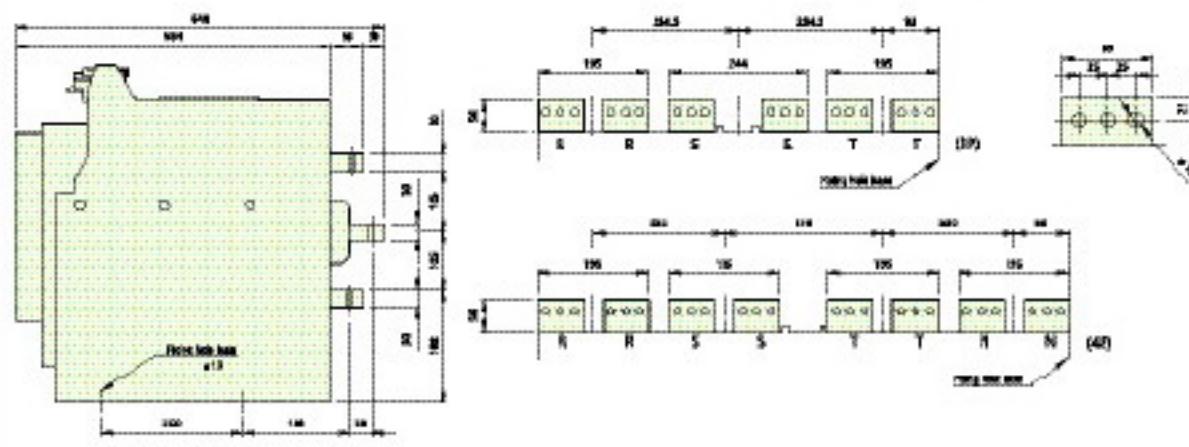




### Circuit Diagram (회로도)

AC 110V, AC 220V

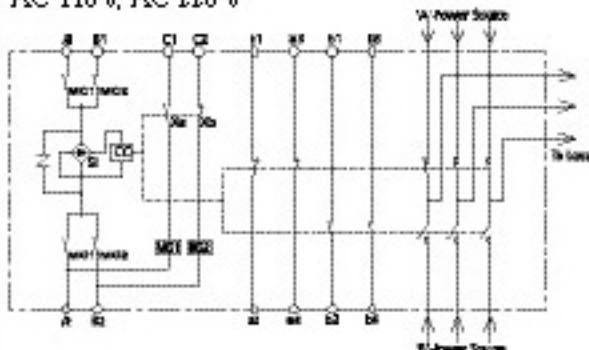

DC 110V, DC 125V

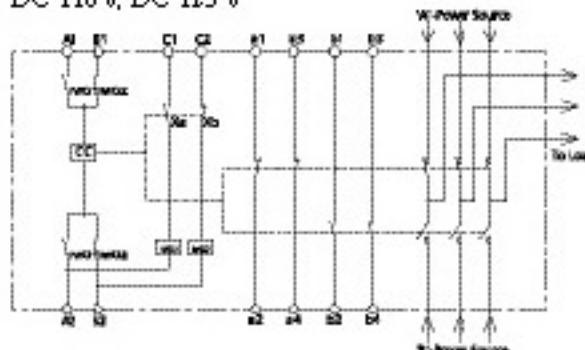


A1 , A2	A-Power Closing Terminal	AX , BX	Control Switch
B1 , B2	B-Power Closing Terminal	MGI , MG2	Magnetic Coil
CC	Closing Coil	a1, a2, a3, a4	A-Power Aux Switch
Si	Silicon Rectifier	b1, b2, b3, b4	B-Power Aux Switch

### Typical Operating Circuit (대표적 조작 회로 예)


Standard

(일반적인 접속)

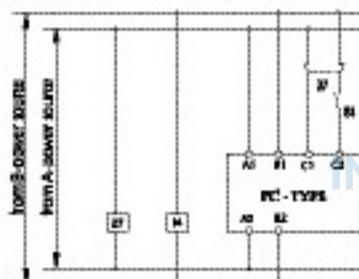


In case of using a changeover switch

(수동-자동 접속)

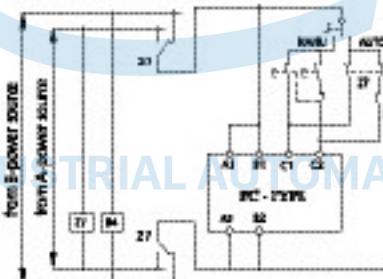


In case of using a timer

(타이머를 이용한 접속)

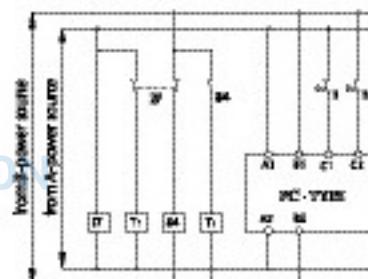


### Wiring Diagram (결선도)

AC Operating and Control

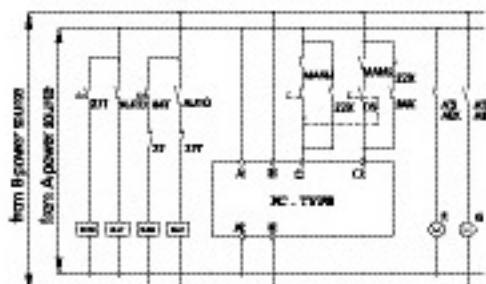

DC Operating and Control

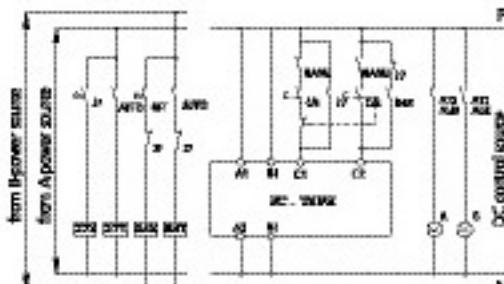

27X	Source-A Operating Relay	SMX	Source-B Operating Relay
27T	27X Operating Delay Relay	SAT	SAN Operating Delay Relay
AUTO,MANU	Automatic, Manual	C/S	Control Switch


Caution : More than 2.0mm<sup>2</sup> power cable used for less than 1,600A ATS.

More than 3.5mm<sup>2</sup> power cable used for more than 2,000A ATS.



## External View (외관명칭)

- ① B-power source indicating LED for Emergency (비상전원 표시 LED)
- ② A-power source indicating LED for Utility (상용전원 표시 LED)
- ③ ATS A-power transfer status indicating LED (ATS 상용전원측 절체 표시 LED)
- ④ SYC(In-phase Monitor) indicating LED (동기절체 표시 LED)
- ⑤ Selection switch of A-power source (상용전원 선택스위치)
- ⑥ Selection switch of B-power source (비상전원 선택스위치)
- ⑦ ATS B-power transfer status indicating LED (ATS 비상전원측 절체 표시 LED)
- ⑧ Selection switch of automatic or manual (자동, 수동 선택스위치)

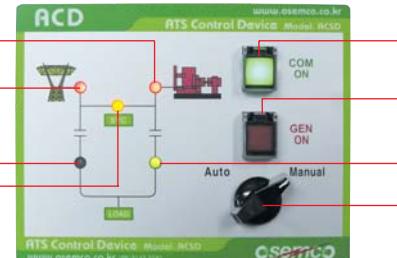

## Specification

- Rated operating voltage : 220VAC
- Frequency : 50 / 60Hz
- Contacts capacity for ATS control : AC250V, 10A (No-load contacts)
- Contacts capacity for Abnormal power source : AC250V, 10A (No-load contacts)
- Fitment : Front Type

## Basic Function

- Automatic or manual ATS control
- Built-in indicator for A-power (Utility), B-power (Emergency) and ATS transfer status
  - Power source : Red LED (Displayed when voltage is above 85%)
  - Transfer status : Green LED
- Manual operation buttons
  - For A-power(Utility) : Green
  - For B-power(Emergency) : Red
  - Note : Built-in LED is on for selective button
- Setting for automatic transfer time
  - Time setting at rear side to avoid unnecessary setting change
  - Variable time settings (0~30sec)
- While timer is working, indicating lamp for transferable ATS is flickered
- Detection for open phase of Utility power source (For 3Ø4W, 220/380VAC only)
- Detection for power failure, and low voltage of Utility source and engine starting contacts provided against abnormal condition

## In-phase Monitor option

- On & Off of In-Phase Monitor can be selected by selection switch
  - When In-Phase Monitor is selected, Transfer is made manually or automatically when synchronized.
  - When In-Phase Monitor is not selected, synchronizing indication lamp is not on.
- When synchronized, Yellow LED is flickered.
- When synchronized more than 3 cycles, Tranfer will be made.
- When button for Utility or Generator will be selected under manual mode, Built-in LED is flickered until synchronizing.

## Ordering Information

- ACD21 (ATS control device) : Basic Function
- ACSD (ATS control synchronizing device) : Built-in In-phase Monitor

## 기본사항

- 동작 전압 : 220VAC
- 주파수 : 50 / 60Hz
- 절체 출력접점 용량 : AC 250V 10A(무 전원 접점)
- 상전 이상 출력(발전기 기동신호) 보조접점용량 : AC 250V 10A(무 전원 접점)
- 부착 방식 : 전면 부착

## 기본기능

- ATS를 자동 또는 수동으로 전환기능
- 상용전원과 비상전원의 표시와 전환상태 표시기능
  - 전원표시 : 적색 LED (전원이 85% 이상 입전시 표시)
  - 전환상태표시 : 녹색 LED
- 수동 조작 버튼의 구성
  - 상용전원 선택버튼 : 녹색
  - 비상전원 선택버튼 : 적색
  - 선택이 가능한 버튼은 내장된 LED가 점등
- 자동 절체시간의 설정기능
  - 후면에서 시한 설정 (임의 조작방지)
  - 설정시간은 가변 설정(0~30초)
- TIMER 동작 중에는 절체 될 ATS 상태표시등을 점멸
- 상용전원의 결상 감지기능
  - 3상 4선식 380/220V에만 적용
- 상용전원의 정전 및 결상, 저전압 등을 감지하고, 이상시 발전기 기동신호 출력

## 동기절체기능 Option




- 선택 스위치에 의해 기능을 ON-OFF 가능
  - 동기기능 선택 시 수동, 자동 모두 동기일 때만 절체
  - 동기기능을 사용 하지 않을 경우에는 동기 램프는 점등 되지 않음
- 동기(SYC) 시 황색 LED가 점멸
- 동기는 3주기 이상 동기가 일치될 경우 절체
- 수동모드에서 상용 또는 비상전원 선택버튼을 누르면 동기를 기다리는 동안 선택버튼에 내장된 LED가 점멸

## 주문 방법


- ACD21 (ATS control device) : 기본 기능
- ACSD (ATS control synchronizer device) : 동기절체 기능 내장




## Wiring Diagram

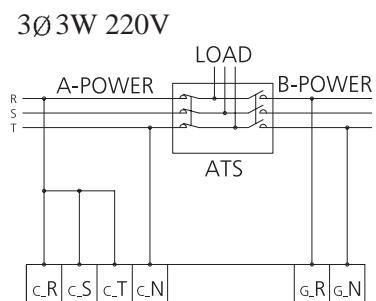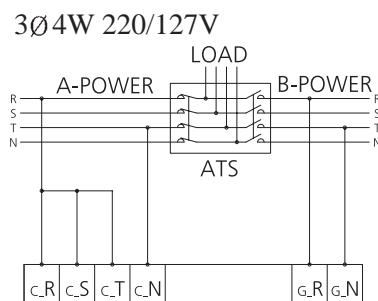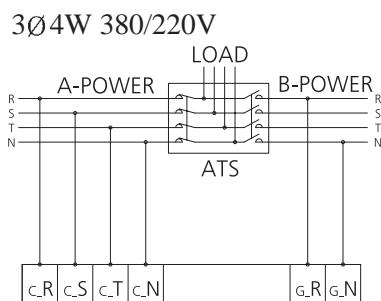



OSS II - T, TB Type  
ATS

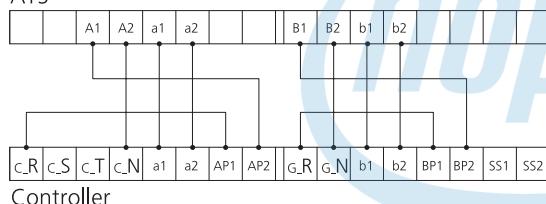

OSS - TN, TBN Type

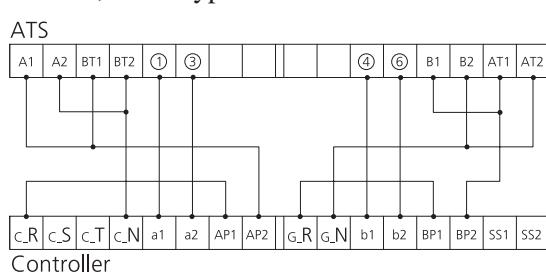


OSS - PC Type

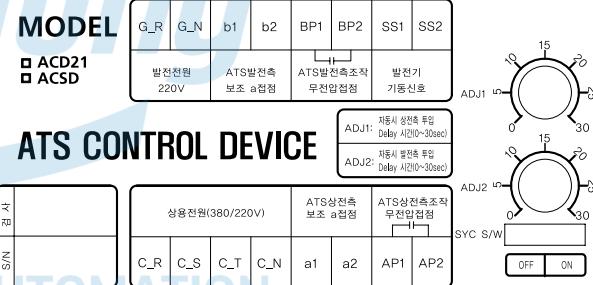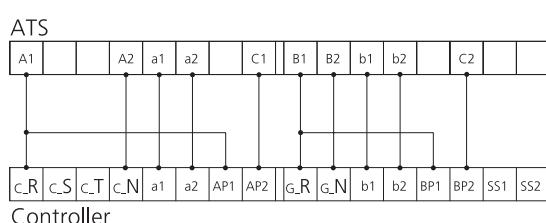

C_R=C_N	A-power source (상용전원)
G_R, G_N	B-power source (비상전원)
AP1, AP2	Operating signal of ATS A-power side (ATS 상용전원측 절체 신호)
BP1, BP2	Operating signal of ATS B-power side (ATS 비상전원측 절체 신호)
a1, a2	Aux a contacts of ATS A-power side (ATS 상용전원측 보조 "a" 접점)
b1, b2	Aux a contacts of ATS B-power side (ATS 비상전원측 보조 "a" 접점)
SS1, SS2	Starting signal of Generator (발전기 기동 신호)
ADJ1	Delayed time setting of Utility side under Auto (0~30sec) (자동 시 상용전원 축 투입시간 설정)
ADJ2	Delayed time setting of Emergency side under Auto (0~30sec) (자동 시 비상전원 축 투입시간 설정)
SYC, S/W	ON/OFF selection of In-phase Monitor (Option) (동기절체기능 ON/OFF 스위치)

## PANEL CUTTING

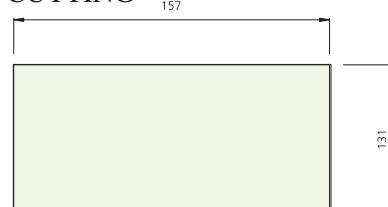

unit : mm



## ■ Standard Operating Conditions (표준 사용환경)

- Ambient Temperature: -5°C~+40°C (but, the average temperature for 24 hours shall be lower than +35°C)
- Altitude: Below 2000m
- Environmental conditions
- Relative humidity shall be less than 85% at max. temp. +40°C, less than 90% at 20°C
- It shall not be allowed to use or store within the area of petrochemicals, ammonia, and corrosive gas.
- Storage Temp.: -20°C~+60°C (but, the average temperature for 24 hours shall be lower than +35°C)
- 주위온도 : -5°C ~ +40°C (단, 24시간 평균온도가 +35°C이하)
- 표고 2000m이하
- 환경조건
- 최대온도 +40°C에서 상대습도 85%이하, 20°C에서는 90%이하
- 유화, 암모니아 및 부식성가스 범위에서는 사용 또는 보관 불가 ( $H_2S \leq 0.01ppm$ ,  $SO_2 \leq 0.01ppm$ ,  $NH_3 \leq a few ppm$ )
- 보관온도 : -20°C ~ +60°C(단, 24시간 평균온도가 +35°C 이하)

## ■ Applicable current by the temperature (온도별 사용전류)

In the case of using under the environment with over than 40°C, please adjust rated current as follows.

기준 주위온도인 40°C를 넘는 환경에서 사용하는 경우는 아래 표와 같이 정격전류를 보정하여 사용하여 주시기 바랍니다.

(Unit / 단위 : Ampere)

Ambient temperature \ Rated current	630A	800A	1000A	1250A	1600A	2000A	2500A	3150A	4000A	5000A
40°C	630	800	1,000	1,250	1,600	2,000	2,500	3,150	4,000	5,000
45°C	630	800	1,000	1,250	1,600	2,000	2,500	3,150	4,000	5,000
50°C	630	800	1,000	1,250	1,600	2,000	2,500	3,150	4,000	5,000
55°C	630	800	1,000	1,250	1,550	2,000	2,450	3,000	3,900	4,850
60°C	630	800	1,000	1,200	1,500	2,000	2,350	2,900	3,750	4,700
60°C ~ 100°C	315	400	500	630	800	1,000	1,250	1,575	2,000	2,500

Note) IEC 60947-1 Standard is applied to the data for 40°C. 주) 주위온도 40°C의 Data는 IEC 60947-1의 규격을 적용하였습니다.

## ■ Bolt tightening torque(for nut) (볼트 체결 토크 (너트의 경우))

Class : 8.8

	M4	M5	M6	M8	M10	M12	M16	M20
Torque(N.m)	2.5~3.2	5.0~6.3	8.7~10.9	21.1~26.4	41.6~52	71.6~89.5	177.6~222	358.4~448

## ■ Selection of TR Capacity

TR capacity should be selected more than the value calculated by the following formula.

$$\text{Operation Voltage} \times \text{Operation Current} \times 0.5 = (\text{VA})$$

e.g.) Operation Voltage AC 220V, Operation Current 4A

$220 \times 4 \times 0.5 = 440\text{VA}$ , TR capacity of more than 440 VA is recommended.

## ■ 조작용 TR용량 선정

조작회로용 TR용량은 하기 계산식에 의한 계산치 이상의 용량을 사용하여 주십시오.

$$\text{조작전압} \times \text{조작전류} \times 0.5 = (\text{VA})$$

예) 조작전압 AC220V 조작전류 4A

$$220 \times 4 \times 0.5 = 440\text{VA}$$

440VA 이상의 TR을 사용하여 주십시오.

## ■ Selection of Control Relay

Voltage Relay 27, 84 and Timer are required to select so that its contact capacity are higher than ATS operation current. Considering chattering of Control Relay, it is safer to select the relay which can break operation current.

Note: If the operating power source is unstable, Voltage setting relay is recommended to use.

## ■ 제어 Relay의 선정

전압 Relay 27, 84 및 Timer는 접점 통전전류가 ATS조작전류 이상의 것을 사용하여 주십시오. 제어 RELAY의 Chattering 등을 고려하여 조작전류의 차단이 가능한 Relay를 선정하여 사용하시면 보다 안전합니다.

주)조작전원이 불안정한 경우에는 전압획립 Relay를 사용하여 주십시오.

Doc No.: KTI03EC05001

## ***EC Declaration of Conformity***

### **O-Sung Electric Machinery Co., Ltd.**

We, #111-3, Youngtae-Ri, Woollong-Myun, Paju-City, Kyungki-do, Korea  
declare under our sole responsibility that the products:

Product : ATSE(Automatic Transfer Switching Equipment)  
Model No.: SS-62-TN

The product identified above is tested by the requirements of the EU Directives of the following standards:

Related standards for Electromagnetic Compatibility Directives 86/336/EEC

EN 60947-6-1: 1991 +A2: 1997	EN 60947-6-1: 1991 +A2: 1997	Low-voltages switchgear and controlgear— Part-6-1: Multiple function equipment— Automatic transfer switching equipment
---------------------------------	---------------------------------	------------------------------------------------------------------------------------------------------------------------------

**INDUSTRIAL AUTOMATION**

Above described products are fully complying with the essential requirements of the EU directives. But, the test report in accordance with EMC directive and others are additionally required, if need.

Issued date: May 02, 2003

Tested by;  
Korea Technology Institute Co., Ltd.


G.C.Chan

Ph.D Gyung Chan, Min / President

Manufactured by;  
O-Sung Electric Machinery Co., Ltd.

H.B. Moon / President

# CÔNG TY CỔ PHẦN CÔNG NGHỆ HỢP LONG



## INDUSTRIAL AUTOMATION



O-Sung Electric Machinery CO., LTD.

五星機電株式會社

### Head Office & Factory

111-3, Youngtae-Ri, Woollong-Myun, Paju-City, Kyungki-Do, Korea

Tel : (82-31)944-3521/3, (82-2)332-6151

Fax : (82-31)944-3525, (82-2)332-6152

Website : <http://www.osemco.com>

E-mail : [osemco1@korea.com](mailto:osemco1@korea.com), [ousung@chol.com](mailto:ousung@chol.com)

### 본사 / 공장

경기도 파주시 월롱면 영태리 111-3

Tel : (031)944-3521/3, (02)332-6151

Fax : (031)944-3525, (02)332-6152

Website : <http://www.osemco.com>

E-mail : [osemco1@korea.com](mailto:osemco1@korea.com), [ousung@chol.com](mailto:ousung@chol.com)

Catalog No. ATS - 0603

\* Information in this catalog may be changed without prior notice in view of continued development.

Hotline: 1900.6536 - Website: [HOPLONGTECH.COM](http://HOPLONGTECH.COM)

\* 본 제품의 사양은 제품의 품질향상 목적으로 예고없이 변경될 수 있습니다.