

DIN W48×H48mm, Universal voltage multi-function timer

■ Features

- Realization of wide range of power supply
:100-240VAC 50/60Hz / 24-240VDC universal,
24VAC 50/60Hz / 24VDC universal, 12VDC
- Various output operation(6 kinds modes)
- Multi time range(16 kinds of time range)
- Wide control time(0.05sec. to 100hour)
- Easy setting of time, time range, output operation mode
- Easy to check output status by LED display



⚠ Please read "Caution for your safety" in operation manual before using.



■ Ordering information

Item	AT 8 N - □	Item	AT 11 DN - □
Power supply	No mark 100-240VAC/24-240VDC 1 12VDC 2 24VAC/DC	Power supply	No mark 100-240VAC/24-240VDC 1 12VDC 2 24VAC/DC
Time operation	N Time limit contact 2c or time limit contact 1c with instantaneous contact 1c by selecting output operation mode	Time operation	DN Time limit 2c EN Time limit 1c, Instantaneous contact 1c
Number of plug pins	8 8-pin plug type	Number of plug pins	11 11-pin plug type
	AT Analog Timer		AT Analog Timer

※Sockets (PG-08, PS-08) are sold separately. ※Sockets (PG-11, PS-11) are sold separately.

■ Specifications

Model	AT8N-□	AT11EN-□	AT11DN-□
Function	Multi function timer		
Control time setting range	0.05 sec. to 100 hour		
Power supply	• 100-240VAC 50/60Hz, 24-240VDC universal • 24VAC 50/60Hz, 24VDC universal • 12VDC		
Allowable voltage range	90 to 110% of rated voltage		
Power consumption	• 100-240VAC : 4.3VA, 24-240VDC : 2W • 24VAC : 4.5VA, 24VDC : 2W • 12VDC : 1.5W		• 100-240VAC:3.5VA, 24-240VDC:1.5W • 24VAC:4VA, 24VDC:1.5 • 12VDC:1W
Reset time	Max. 100ms		
Min. input signal width	START INHIBIT RESET	—	Min. 50ms
Input	START INHIBIT RESET	—	No-voltage input - Short-circuit impedance : Max. 1kΩ Residual voltage : Max. 0.5V Open-circuit impedance : Min. 100kΩ
Timing operation	Power ON start type		Signal ON Start type
Control output	Contact type	Time limit DPDT(2c), Time limit DPDT(1c)+ Instantaneous DPDT(1c) by selecting output operation mode	Time limit SPDT(1c), Instantaneous SPDT(1c)
	Contact capacity	Time limit DPDT(2c)	
Relay	Mechanical	Min. 10,000,000 operations	
life cycle	Electrical	Min. 100,000 operations(250VAC 5A resistive load)	
Repeat error	Max. ±0.2% ±10ms		
SET error	Max. ±5% ±50ms		
Voltage error	Max. ±0.5%		
Temperature error	Max. ±2%		
Insulation resistance	Min. 100MΩ(at 500VDC megger)		
Dielectric strength	2000VAC 50/60Hz for 1 minute		
Environ-ment	Ambient temperature	-10 to 55°C, storage: -25 to 65°C	
	Ambient humidity	35 to 85%RH	
Approval	CE c UL US		
Accessory	Bracket		
Unit weight	Approx. 90g		

※Environment resistance is rated at no freezing or condensation.


(A) Photo electric sensor
(B) Fiber optic sensor
(C) Door/Area sensor
(D) Proximity sensor
(E) Pressure sensor
(F) Rotary encoder
(G) Connector/ Socket
(H) Temp. controller
(I) SSR/ Power controller
(J) Counter
(K) Timer
(L) Panel meter
(M) Tacho/ Speed/ Pulse meter
(N) Display unit
(O) Sensor controller
(P) Switching mode power supply
(Q) Stepper motor& Driver&Controller
(R) Graphic/ Logic panel
(S) Field network device
(T) Software
(U) Other

ATN Series

■ Connections


○ AT8N

- [A], [F] mode

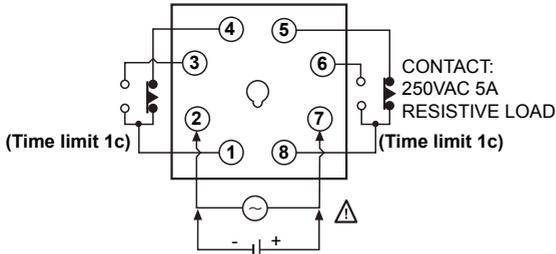


SOURCE:
 • 100-240VAC 50/60Hz, 24-240VDC
 • 24VAC 50/60Hz, 24VDC
 • 12VDC

- [A1], [B], [F1], [I] mode

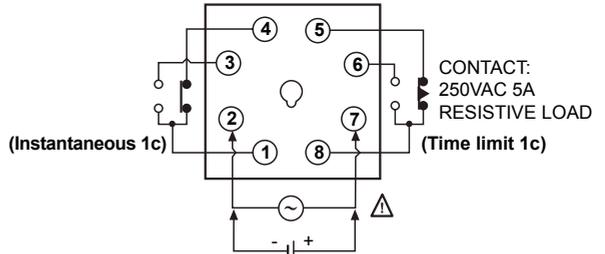


SOURCE:
 • 100-240VAC 50/60Hz, 24-240VDC
 • 24VAC 50/60Hz, 24VDC
 • 12VDC

○ AT11DN

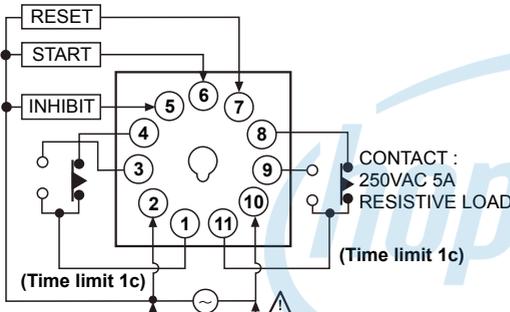

SOURCE:
 • 100-240VAC 50/60Hz, 24-240VDC
 • 24VAC 50/60Hz, 24VDC
 • 12VDC



○ AT11DEN

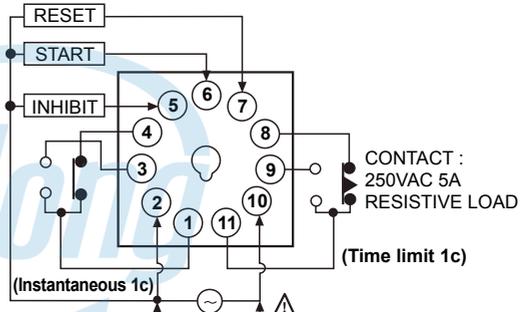



SOURCE:
 • 100-240VAC 50/60Hz, 24-240VDC
 • 24VAC 50/60Hz, 24VDC
 • 12VDC

■ Dimensions

- Bracket

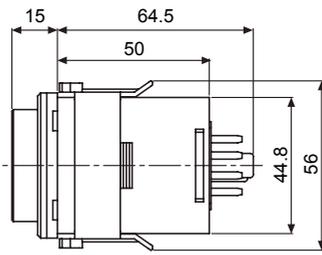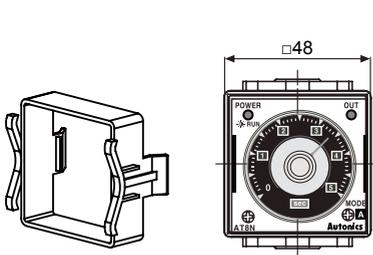

- Panel cut-out

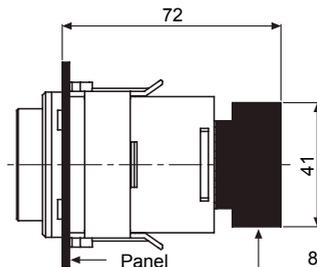


8-pin socket : PG-08 (Sold separately)
 11-pin socket : PG-11 (Sold separately)
 ※Refer to the G-15 page.

INDUSTRIAL AUTOMATION

(unit: mm)

Parts description

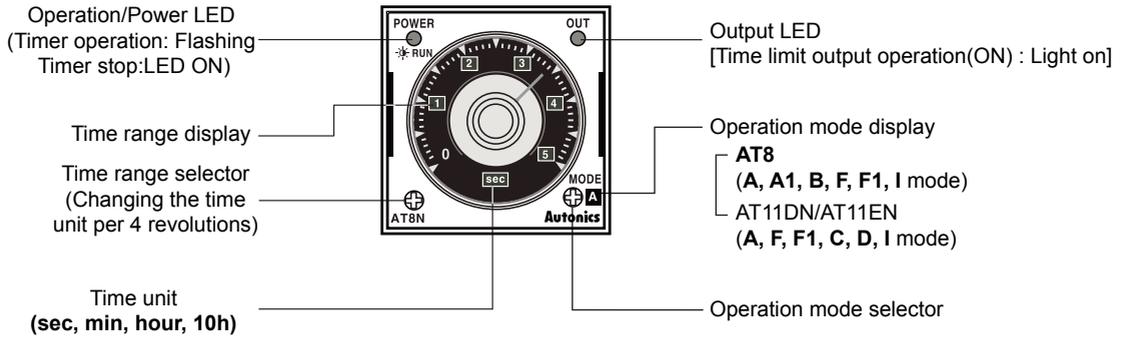

※Please rotate the time range switch and operation mode switch to CW(Clockwise) direction.

Time specifications

Time range	Time unit	Time setting range
0.5	sec	0.05 to 0.5 sec.
1.0		0.1 to 1.0 sec.
5		0.5 to 5 sec.
10		1 to 10 sec.
0.5	min	0.05 to 0.5 min.
1.0		0.1 to 1.0 min.
5		0.5 to 5 min.
10		1 to 10 min.
0.5	hour	0.05 to 0.5 hour
1.0		0.1 to 1.0 hour
5		0.5 to 5 hour
10		1 to 10 hour
0.5	10h	0.5 to 5 hour
1.0		1 to 10 hour
5		5 to 50 hour
10		10 to 100 hour

Output operation mode of each model

• AT8N

Display	Output operation mode
A	Power ON Delay
A1	Power ON Delay 1
B	Power ON Delay 2
F	Flicker (OFF Start)
F1	Flicker 1 (ON Start)
I	Interval

• AT11DN/AT11EN

Display	Output operation mode
A	Signal ON Delay
F	Flicker (OFF Start)
F1	Flicker 1 (ON Start)
C	Signal OFF Delay
D	Signal ON/OFF Delay
I	Interval

(A)	Photo electric sensor
(B)	Fiber optic sensor
(C)	Door/Area sensor
(D)	Proximity sensor
(E)	Pressure sensor
(F)	Rotary encoder
(G)	Connector/Socket
(H)	Temp. controller
(I)	SSR/Power controller
(J)	Counter
(K)	Timer
(L)	Panel meter
(M)	Tacho/Speed/ Pulse meter
(N)	Display unit
(O)	Sensor controller
(P)	Switching mode power supply
(Q)	Stepper motor& Driver&Controller
(R)	Graphic/ Logic panel
(S)	Field network device
(T)	Software
(U)	Other

■ AT8N Output operation mode


[t:Setting time, $t > t-a$, Rt:Return time, $Rt1 > Rt$]

Mode	Time chart
A Power ON Delay	
A1 Power ON Delay 1 (One-shot output)	<p>※One-shot output is 0.5sec fixed.</p>
B Power ON Delay 2	
F Flicker	
F1 Flicker 1	
I Interval	

※When using F, F1 output operation modes, if the time is set too short, the output may not work properly. Please set the time at least over 100ms.

■ AT11DN/AT11EN Output operation mode

[t:Setting time, $t=t_1+t_2$, $t>t-a$]

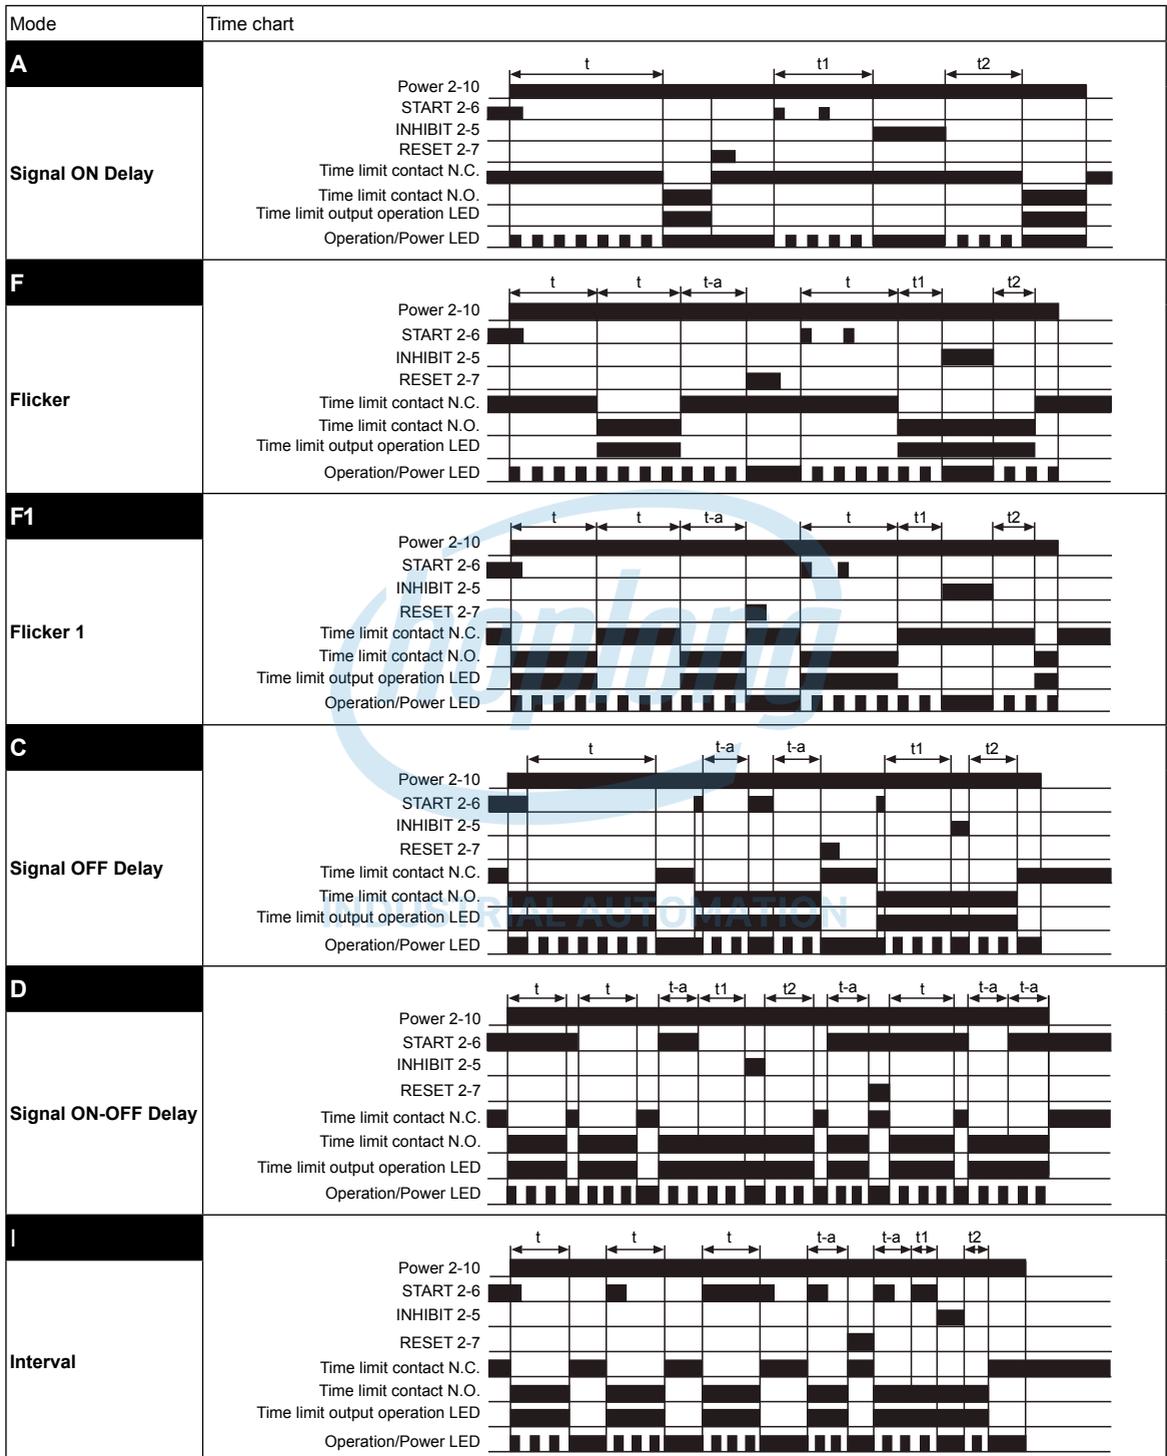



- ※1: If power is removed or the RESET terminal is short-circuited, the timer will be reset.
- 2: If the INHIBIT terminal is short-circuited during a timing cycle, the time will stop.
- 3: When using F, F1 output operation modes, if the time is set too short, the output may not work properly. Please set the time at least over 100ms.

(A) Photo electric sensor
(B) Fiber optic sensor
(C) Door/Area sensor
(D) Proximity sensor
(E) Pressure sensor
(F) Rotary encoder
(G) Connector/ Socket
(H) Temp. controller
(I) SSR/ Power controller
(J) Counter
(K) Timer
(L) Panel meter
(M) Tacho/ Speed/ Pulse meter
(N) Display unit
(O) Sensor controller
(P) Switching mode power supply
(Q) Stepper motor& Driver&Controller
(R) Graphic/ Logic panel
(S) Field network device
(T) Software
(U) Other

■ Proper usage


◎ Repeat function(Flicker)

- It enables to use one ATN timer for 3 sub relays and 2 timers (Flicker function).
Simple to use flicker function with only one ATN timer.
- Switch A : Start, Switch B : Reset.

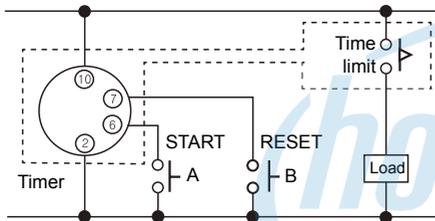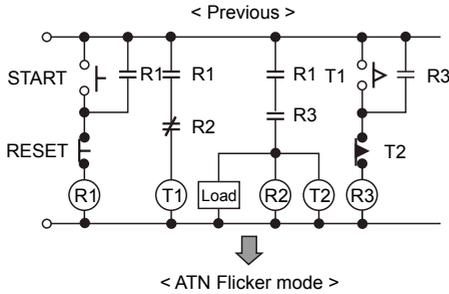

◎ Interval mode

It enables to make instantaneous ON and time limit OFF (remained circuit) with using Interval mode.

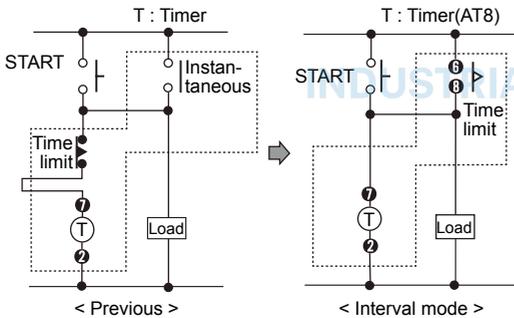


◎ Input signal condition(AT11DN, AT11EN)

1. Relay contact input

Please use gold-plated switches with good contact assurance and short bouncing time for contact input. (Open resistance : Over 100kΩ, Short-circuit resistance: Under 1kΩ)
※Please use a contact that can function reliably at 5VDC 0.4mA.


2. Input with NPN open collector type

Characteristics of transistor should be $V_{ce0} = \text{min. } 25V$, $I_c = \text{min. } 10mA$, $I_{cbo} = \text{max. } 0.2\mu A$, residual voltage = max. 0.5V.

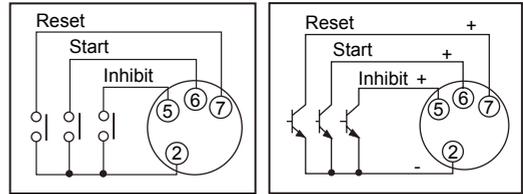

3. NPN universal input

It enables to use voltage output type as input signal source instead of open collector output in solid-state circuit (proximity sensor, photo-electric sensor) which has range of 10-30VDC output voltage. When H signal change to L, timer will start. When transistor(Q) is ON status, please make residual voltage under 0.5V.

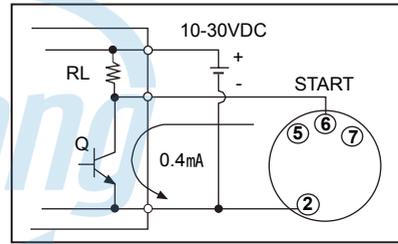

◎ Terminal connection

- Please wire correctly with wiring instructions
- Power connection
Connect the power line without observing polarity for ATN series AC power type, but please be careful of power connection for DC power type.

Power supply	8-pin Type	11-pin Type
AC Type	Terminal ② - ⑦	Terminal ② - ⑩
DC Type	Terminal ② ← ⊖	Terminal ② ← ⊖
	Terminal ⑦ ← ⊕	Terminal ⑩ ← ⊕


- When turning off the power, be careful of inductive voltage. (If using power line with another high voltage line or energy line near by, it may cause inductive voltage).
- Power ripple should be under 10% and power supply should be within range of allowable voltage for DC power type.
- Please supply the power quickly when using a switch or a relay contact. Otherwise, it may cause time error or power reset failure.
- The load of Control output should be under rated load capacity.

⦿ Setting time, time range, operation mode


Do not change time range or operation mode while time operating. When changing it, please power off or apply reset signal.

⦿ Input connection


- AT11DN/AT11EN Timer is non-transformer type, therefore please check following for connecting relay contact for input signal and transistor.

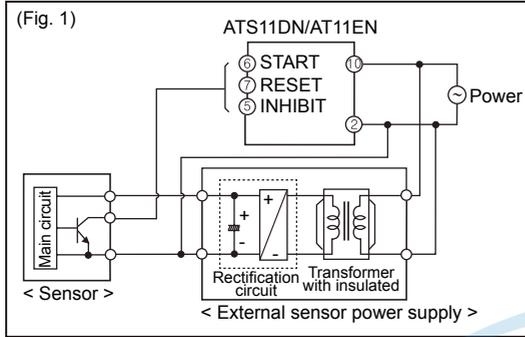

- When using the terminal ⑥ as a common terminal of input signal as (Fig. 2), it may cause damage to the inner circuit of AT11DN/AT11EN, please use the terminal ② for common terminal as (Fig. 3).

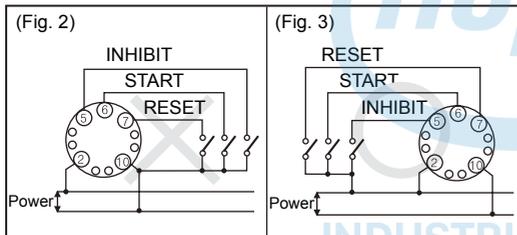


- When using more than one timer with one contact or transistor input, the short current is flowed when it is connected as (Fig. 4). Please connect the power phase correctly as (Fig. 5) correctly.

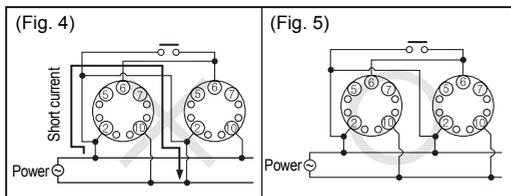

- INHIBIT, START, RESET signal applied by short input terminal ②-⑤, ②-⑥ or ②-⑦. It may cause internal circuit damaged by wrong connection.
- If using power line with another high voltage line or energy line at the same conduit, it may cause inductive voltage. Therefore please use separated conduit for power line.
- When input(INHIBIT, START, RESET) wire is long, please use shield wire and it should be short.

⦿ Common

- For DC power supply type, be sure to check the polarity of terminals.
- In case of 12VDC, 24VAC/DC model, isolated and limited voltage/current or Class 2 source should be provided for power supply.
- When supply the power to the timer, connection shown in (Fig. 6) might cause malfunction due to leakage current through R and C. Please connect R and C as shown in (Fig. 7) to prevent malfunction.

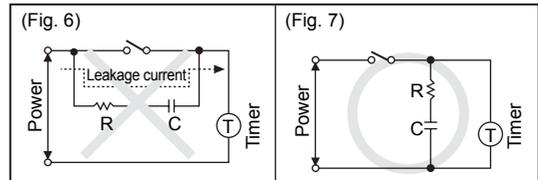

- It might cause malfunction if changing the setting time, time range or operation mode during operating unit. Please change the the setting time, time range or operation mode after cut the power off.
- Do not use this unit at below places.
 - Place where there are severe vibration or impact.
 - Place where strong alkalis or acids are used.
 - Place where there are direct rays of the sun
 - Place where strong magnetic field or electric noise are generated.
- Installation environment
 - It shall be used indoor
 - Altitude Max. 2000m
 - Pollution Degree 2
 - Installation Category II

(A)	Photo electric sensor
(B)	Fiber optic sensor
(C)	Door/Area sensor
(D)	Proximity sensor
(E)	Pressure sensor
(F)	Rotary encoder
(G)	Connector/Socket
(H)	Temp. controller
(I)	SSR/ Power controller
(J)	Counter
(K)	Timer
(L)	Panel meter
(M)	Tacho/ Speed/ Pulse meter
(N)	Display unit
(O)	Sensor controller
(P)	Switching mode power supply
(Q)	Stepper motor& Driver&Controller
(R)	Graphic/ Logic panel
(S)	Field network device
(T)	Software
(U)	Other